




THE INFORMATION ON THIS DRAWING IS TO THE ORDNANCE SURVEY IRELAND ITM COORDINATE SYSTEM

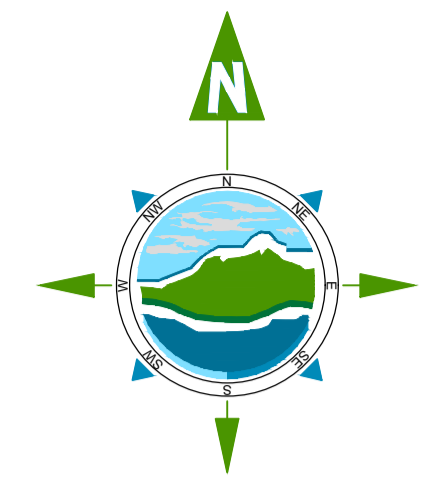

**LEGEND:**

EXISTING WATERMAIN	
PROPOSED WATERMAIN	
EXISTING SLUICE VALVE	
EXISTING AIR VALVE	
EXISTING HYDRANT	
EXISTING BULK METER	

- NOTES:**
- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
  - ALL DRAWINGS TO BE CHECKED BY THE CONTRACTOR ON SITE.
  - ENGINEER/EMPLOYERS REPRESENTATIVE, AS APPROPRIATE, TO BE INFORMED BY THE CONTRACTOR OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
  - THE CONTRACTOR SHALL UNDERTAKE A THOROUGH CHECK FOR THE ACTUAL LOCATION OF ALL SERVICES/UTILITIES, ABOVE AND BELOW GROUND, BEFORE ANY WORK COMMENCES.
  - ALL LEVELS SHOWN RELATE TO ORDNANCE SURVEY DATUM AT MALIN HEAD.

Rev	Date	Description	By	Chkd.
P0	25-02-2025	Issue for Planning	CP	SB

Client: Galway County Council

Project: New Brigade Mechanics Workshop At Athenry Fire Station

Title: Proposed Watermain Layout

Scale @ A1: 1:250  
 Prepared by: CP Checked by: SB Date: 25-02-2025

Drawing Status: Planning

**TOBIN**  
 Tel: +353 (0)91 565 211  
 Email: info@tobin.ie  
 www.tobin.ie

Drawing No.: 12084-2001  
 Revision: P0

- WATERMAIN:**
- WATERMAIN INFRASTRUCTURE TO BE CONSTRUCTED IN ACCORDANCE WITH IRISH WATER SPECIFICATION IW-CDS-5020-03
  - AS PER SECTION 3.15.4 OF THE IRISH WATER CODE OF PRACTICE FOR WATER INFRASTRUCTURE. FACILITIES TO MEASURE EACH INDIVIDUAL RESIDENTIAL AND NON-RESIDENTIAL UNITS SHALL BE PROVIDED IN A PUBLICLY ACCESSIBLE LOCATION.
  - AIR VALVES AND HYDRANTS TO COMPLY WITH 3.18 OF THE CODE OF PRACTICE
  - PIPE MATERIAL SHALL BE HDPE OR MDPE IN ACCORDANCE WITH SECTION 3.9 AND SHALL COMPLY WITH SECTION 3.9 OF THE IRISH WATER CODE OF PRACTICE.
  - THRUST BLOCKS TO WATERMAINS AS PER IW STANDARDS DETAIL STD - W - 28