

Notes:
The Public Lighting design has been prepared with reference to the CIBSE Lighting Guide LG06, the Institute of Lighting Professionals Document – Guidance Notes for the Reduction of Obtrusive Light GN01:2021 and Guidance Notes for Bats and Artificial Lighting at Night GN08:2023.

The design shall fully comply with IS EN13201 Lighting Class P3.

Public Lighting Ducting is to be red high density polyethylene ducts stamped 'street lighting' or 'public lighting' and be in accordance with Sligo County Council Public Lighting requirements.

The Contractor shall ensure that all ESBN supply points, public lighting pillars, columns, ducts and cables are installed outside the boundaries of private property.

All columns shall be of tapered octagonal construction, fabricated from 3mm sheet steel or of tubular steel construction with a minimum wall thickness of 3mm. No circumferential butt-welding shall be used in column construction. Columns shall comply with SCC street lighting division requirements & specifications.

Columns shall have fitted compartment doors set at a height of 1.5m to centre of opening above finished road level and normally faced away from oncoming traffic. The outside of the planted portion of all columns shall be protected by a bituminous coating extending to a height of 150mm above ground level.

All ducts shall be uPVC complying with BS3506 Class B or High Density Polythene Pipe to IS135 Class B.


Minimum sizes to be 50mm or 100mm as per the drawing with 100mm spare ducts installed at road crossing.

All ducts shall be placed outside the boundaries of properties and shall not at any time pass through ESB or EIR telecom chambers. The contractor shall ensure that spare 50mm ducts are laid across all driveway aprons. Spare 100mm duct shall be provided at each road crossing. In all situations electrical hazard warning tape as per ET10101:2020 shall be laid at the appropriate depth.

Cabling deployed for street lighting shall be minimum 2x6mm SQ NYCY complying with VDE 0271/5.


A bare copper or hot dip galvanised iron earth rod 16mm diameter shall be sunk to a minimum depth of 1200mm adjacent to each service pillar. Earth rods shall be installed with suitable inspection boxes to facilitate inspection of the earth conductor connection to the rod.

Electrical contractor shall refer to Galway County Council guidelines for public lighting works and ensure that their installation fully complies with this document.

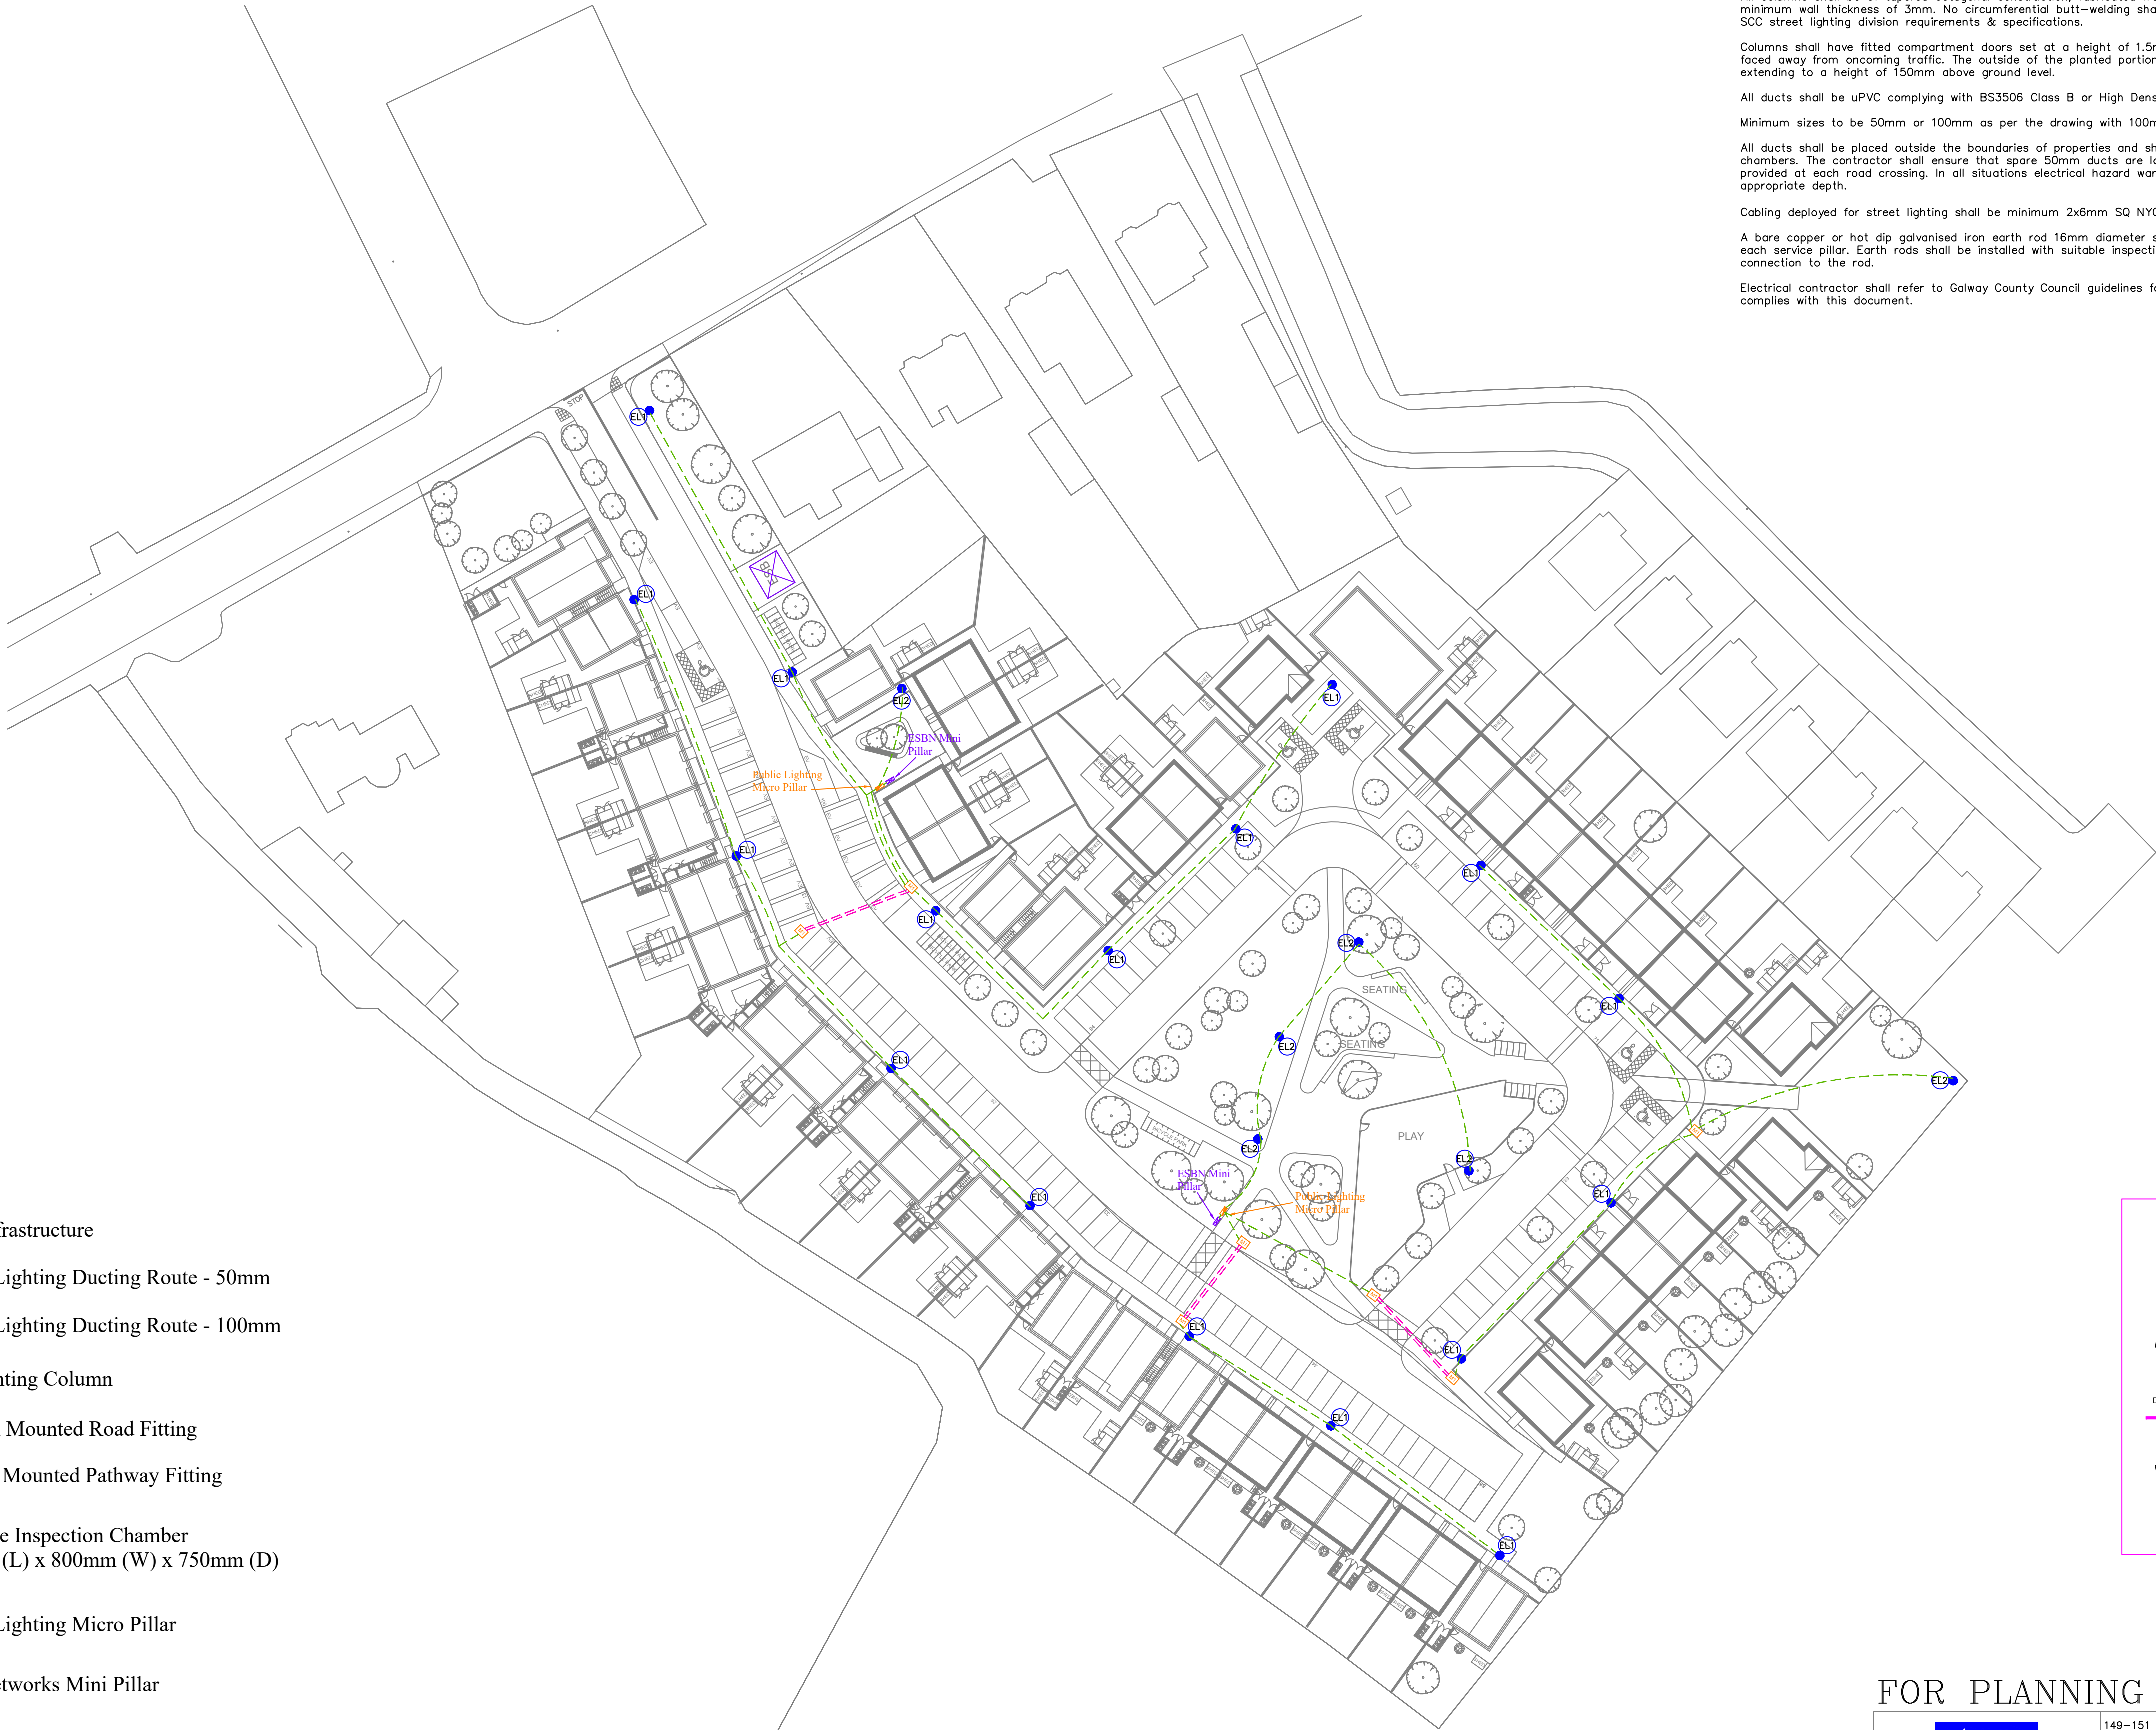

Legend

- ESB Infrastructure
- Public Lighting Ducting Route - 50mm
- Public Lighting Ducting Route - 100mm
- 6m Lighting Column
- Column Mounted Road Fitting
- Ground Mounted Pathway Fitting
- Concrete Inspection Chamber
800mm (L) x 800mm (W) x 750mm (D)
- Public Lighting Micro Pillar
- ESB Networks Mini Pillar

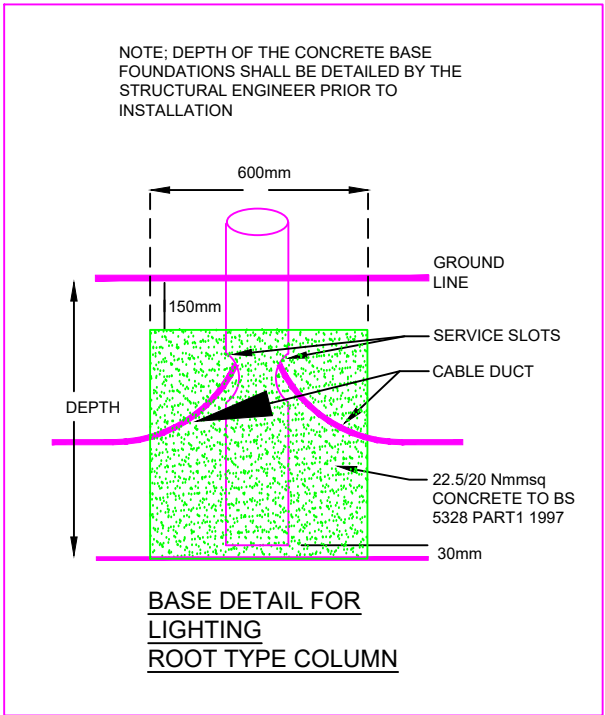

FOR PLANNING

 design MECHANICAL & ELECTRICAL CONSULTANTS	149-151 Albertbridge Road, Belfast BT5 4PS E-mail: info@ahdesign.biz			Tel 028 9046 1331 Fax 028 9046 1818 Website: www.ahdesign.biz			
	PROJECT PROPOSED NEW-BUILD RESIDENTIAL DEVELOPMENT FARRANNAMARTIN, GALWAY ROAD, TUAM, CO. GALWAY.						
	TITLE PUBLIC LIGHTING INFRASTRUCTURE						
	PROPOSED SITE LAYOUT						
DRAWN	DW	CHECKED	AH	SCALE	DATE	PRJ No.	DWG No.
				1:500@A1	APR'25	2451	ESK02