


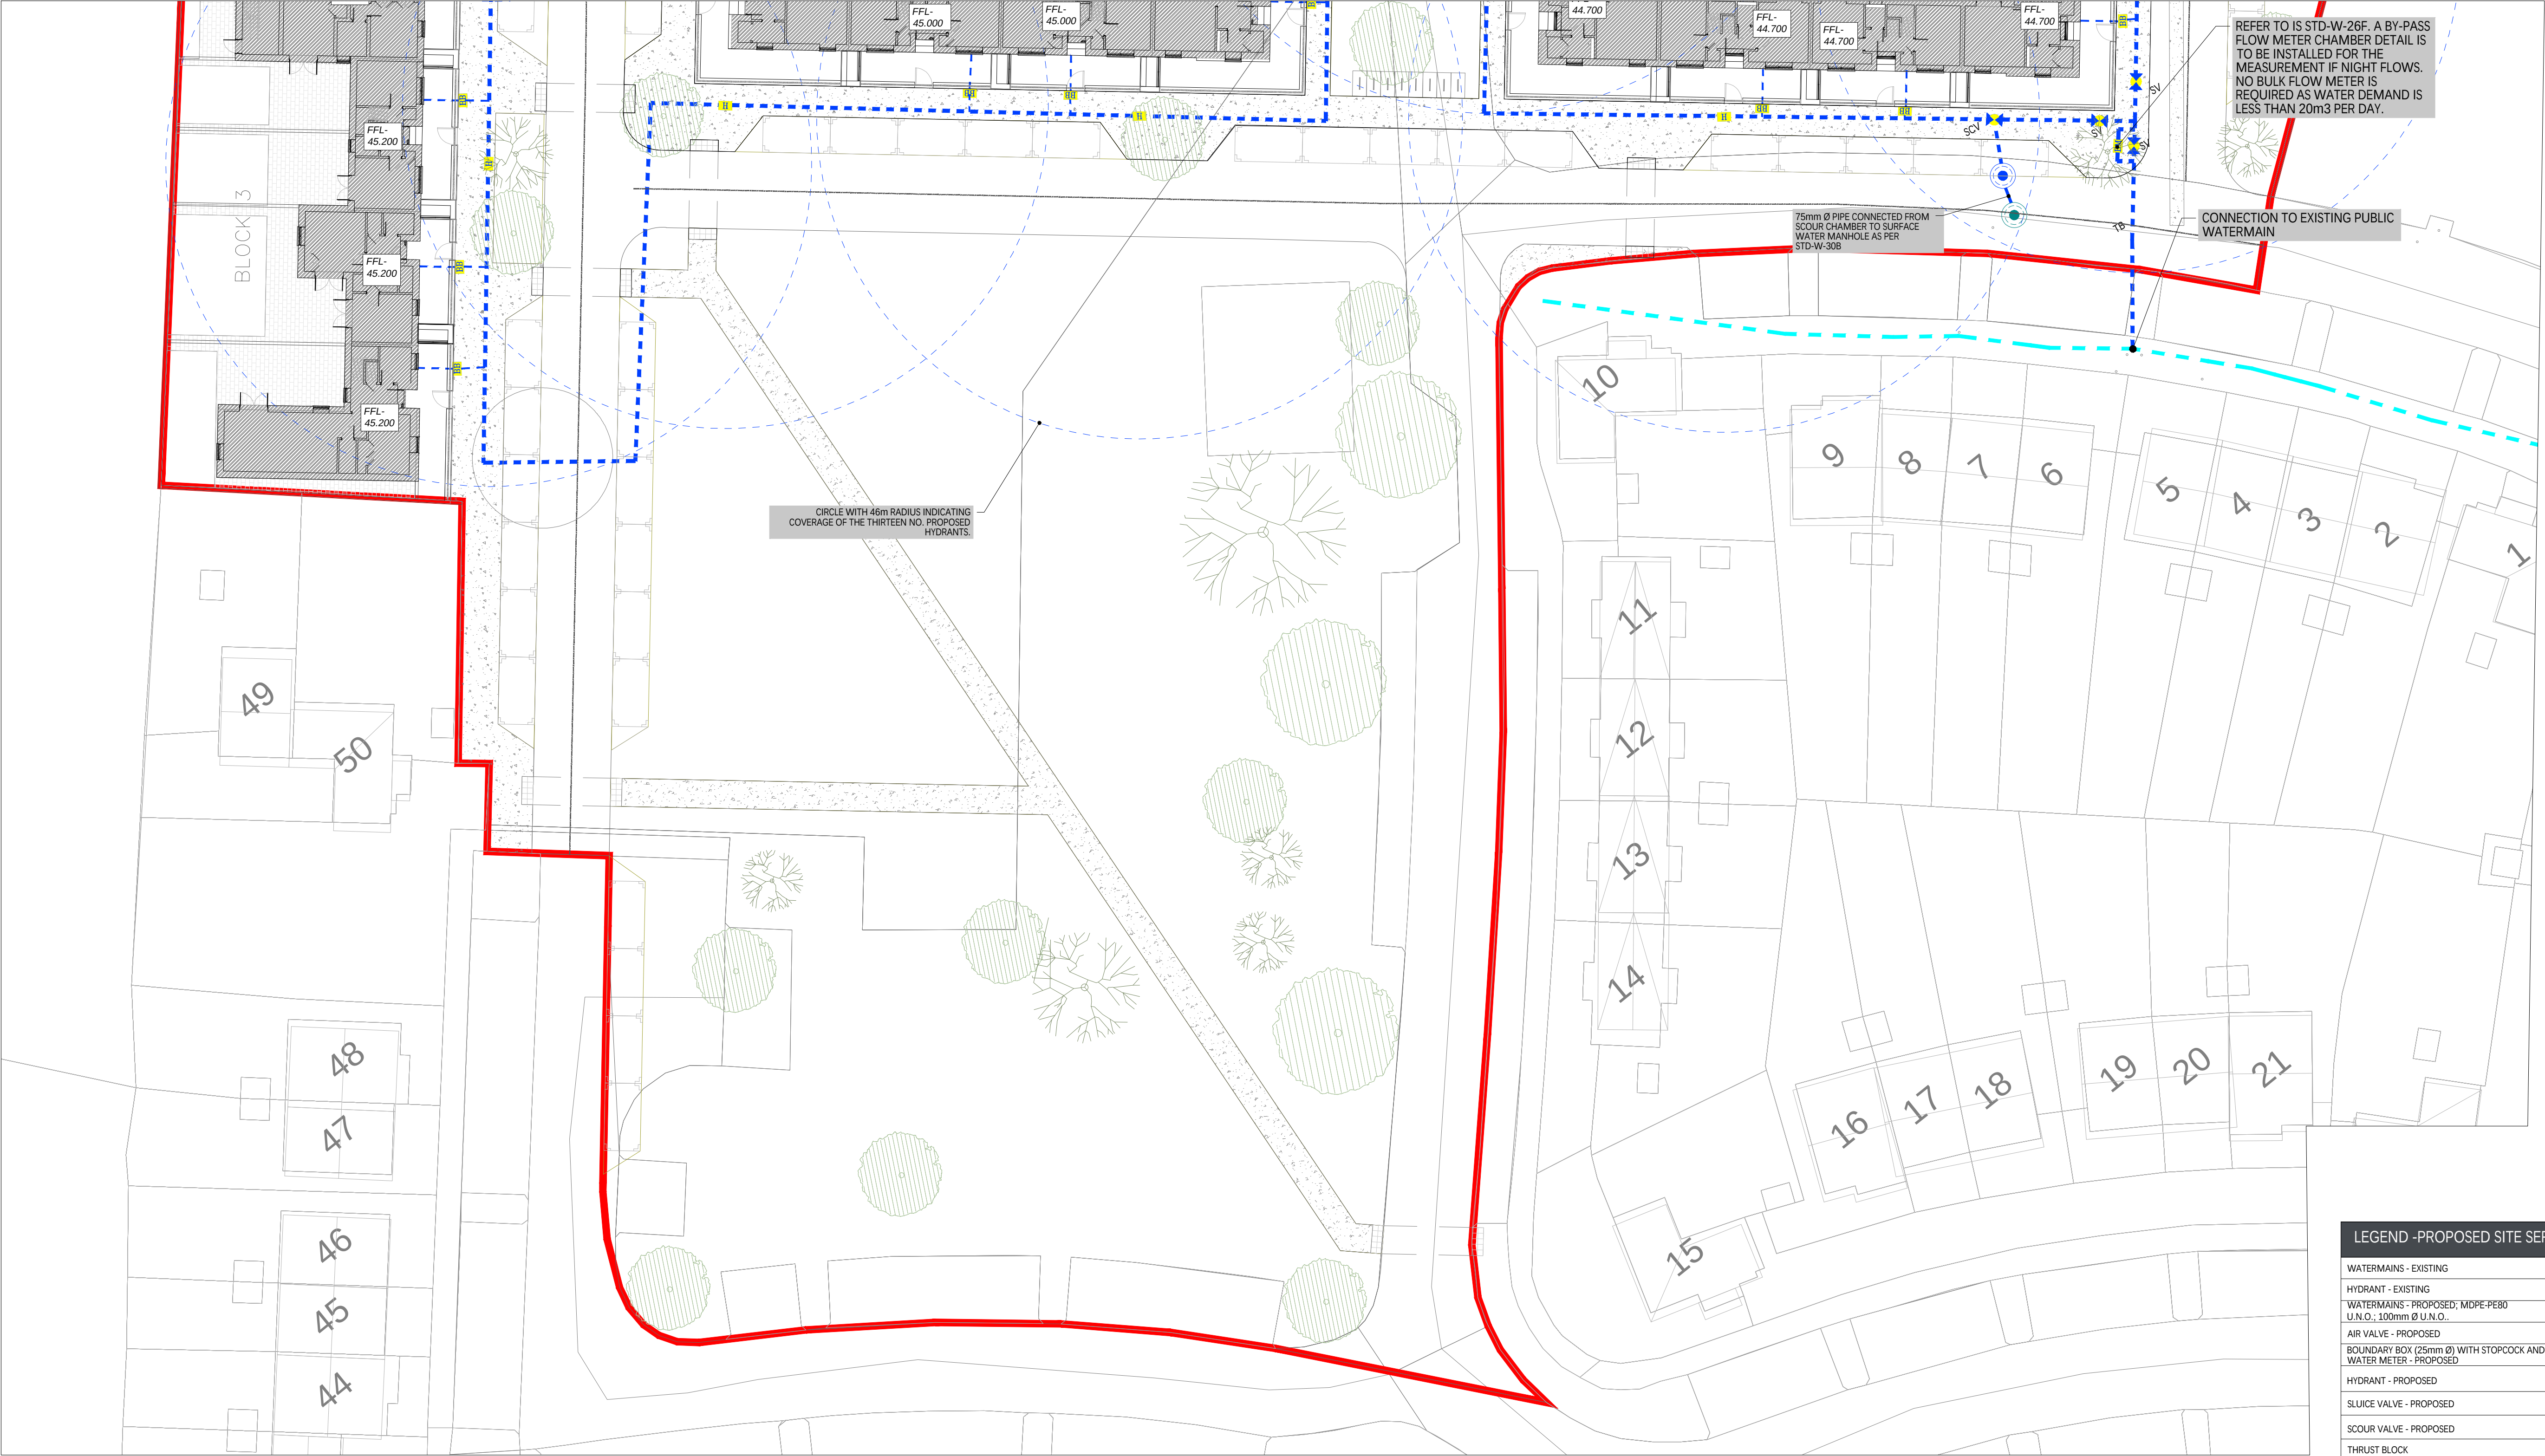

LEGEND -PROPOSED SITE SERVICES-WATERMAIN	
WATERMAINS - EXISTING	---
HYDRANT - EXISTING	[H]
WATERMAINS - PROPOSED; MDPE-PE80 U.N.O.; 100mm Ø U.N.O.	---
AIR VALVE - PROPOSED	[AV]
BOUNDARY BOX (25mm Ø) WITH STOPCOCK AND WATER METER - PROPOSED	[BB]
HYDRANT - PROPOSED	[H]
SLUICE VALVE - PROPOSED	[SV]
SCOUR VALVE - PROPOSED	[SCV]
THRUST BLOCK	[TB]
WATER METER (SINGLE UNIT) - PROPOSED	[M]
WATER METER (DEVELOPMENT) - PROPOSED (BYPASS FLOW METER AS PER IW DETAIL, STD-W-26F)	[BM]

ALL WATER INFRASTRUCTURE TO BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH:

- CODE OF PRACTICE FOR WATER INFRASTRUCTURE, CONNECTIONS AND DEVELOPER SERVICES, DESIGN AND CONSTRUCTION REQUIREMENTS FOR SELF-LAY DEVELOPMENTS; JULY 2020 (REVISION 2); IW-CDS-6020-03
- WATER INFRASTRUCTURE STANDARD DETAILS, CONNECTIONS AND DEVELOPER SERVICES, CONSTRUCTION REQUIREMENTS FOR SELF-LAY DEVELOPMENTS; JULY 2020 (REVISION 04); IW-CDS-6020-01

WHERE THE ABOVE DOCUMENTS ARE REVISED BY IW, THE LATEST REVISION OF THE RELEVANT DOCUMENT SHALL BE USED.

NOTE:
ALL PIPE MATERIALS SHALL BE IN COMPLIANCE WITH SECTION 3.9 OF THE IRISH WATER CODE OF PRACTICE

CIVIL, STRUCTURAL & BUILDING ENGINEERS
DUBLIN • LONDON • CASTLEBAR • SPAIN

Head Office: Unit 9, N5 Business Park, Castlebar, Co. Mayo F23 E283. Tel: +353 (0)94 9034914
Dublin: Silverdale, Old Swords Road, Dublin 9, D19 CA24. Tel: +353 (0)1 6877480
London: Bridge House, 25-27 The Bridge, Wealdstone, Harrow, HA3 5AB. Tel: +44 (0)20-30266724
Spain: Calle Virgen de Guadalupe, 44. Libreta, 23400, Jaén.
✉ info@structuraldesign.ie Web: www.structuraldesign.ie

SDS
design engineers

DRAWING NOTES:			
1. This Drawing is to be read in conjunction with the relevant Specifications & other Architectural & Engineering Drawings. Engineers to be informed immediately of any discrepancies before work proceeds.			
2. Do Not Scale from this Drawing. -Metric Figured Dimension only are to be used.			
3. It is "The Contractors" responsibility to ensure that all works are carried out in accordance with the requirements of the current Building Regulations and all other statutory documents relevant to this project including the grant of planning permission, Fire Safety Certificate and Disability Access Certificate.			
4. SDS (Structural Design Solutions) Ltd./ SDS-UK (Structural Design Solutions) Ltd. bear no liability for unilateral changes/modifications made during the course of construction based on the drawing prepared, without prior consultation and confirmation of acceptance of the revision by SDS (Structural Design Solutions) Ltd./ SDS-UK (Structural Design Solutions) Ltd.			
PL.2	11.04.2025	MW	UPDATED FROM COMMENTS
PL.1	31.01.2025	MW	ISSUED FOR PLANNING
REV.	DATE:	BY:	DESCRIPTION:

Client: GALWAY COUNTY COUNCIL

Project Title: PROPOSED HOUSING DEVELOPMENT AT GORT MHAOLIR, ATHENRY, CO GALWAY

Drawing Title: SITE LAYOUT - SERVICES: WATERMAIN. SHEET 2

Scale:	1:250	Page Size:	A1	Status:	PLANNING
Drawn by:	MW	Date:	JANUARY 2025	Checked:	CD
P:\SDS\2025\01 - Galway CC - PPA - Athenry Housing Scheme Drawings\3.1.A - PLANNING & CIVIL MAINS\03.1.B.1 - SITE.1022.dwg					
Project No:	24181-A	Drawing No:	3025	Revision:	PL.2