




PUBLIC LIGHTING

- Luminaire A Streetlight 28w LED Street Optic R02 Lamp 12LED 3000K MF 0.76
- Luminaire B Streetlight 28w LED Forward Throw Optic Lamp 12LED 3000K MF 0.76
- Luminaire C Streetlight 28w LED Forward Throw Optic Lamp 12LED 3000K MF 0.76
- ESB Minipillar - To ESB Standard
- Public Lighting Micro Pillar - To ESB Standard
- Underground 150mm Ducting
- Underground 50mm Ducting
- Unit Sub





36w LED on 6m Pole - By Electrical Contractor

ESB - All ESB infrastructure is to be installed in accordance with ESB publication "Guidebook for housing schemes"

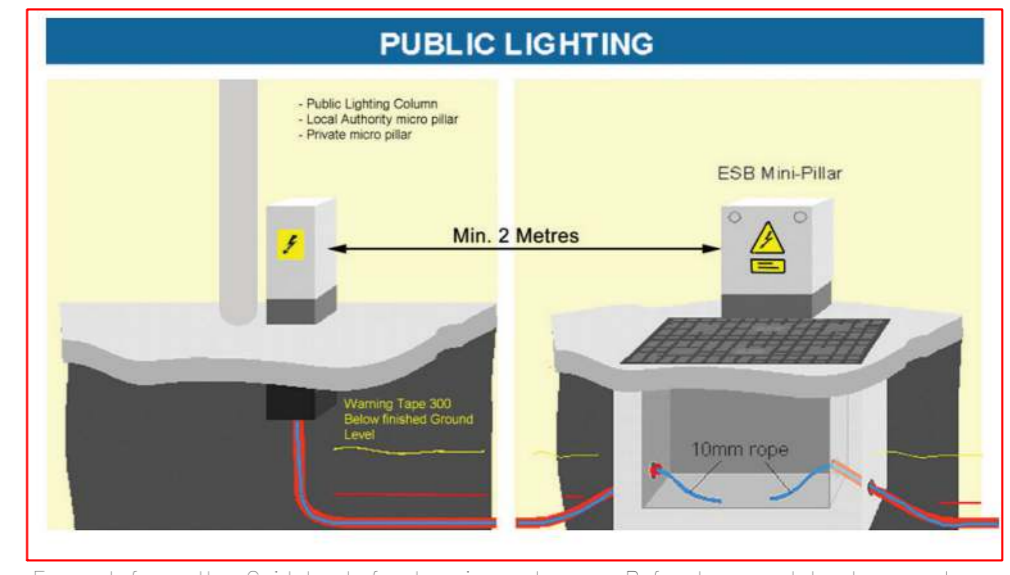

Excerpt from the Guidebook for housing schemes. Refer to complete document for all details required.

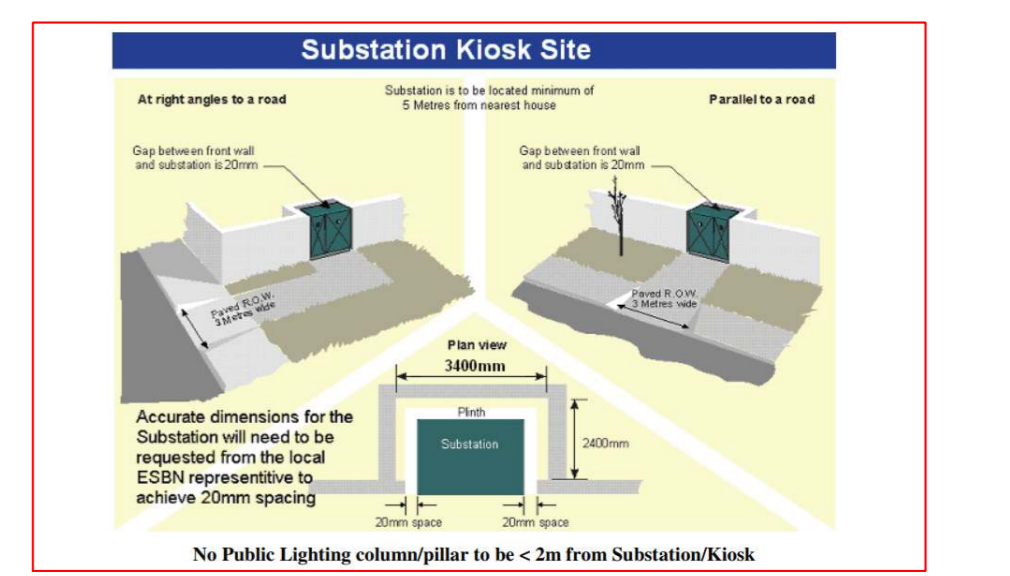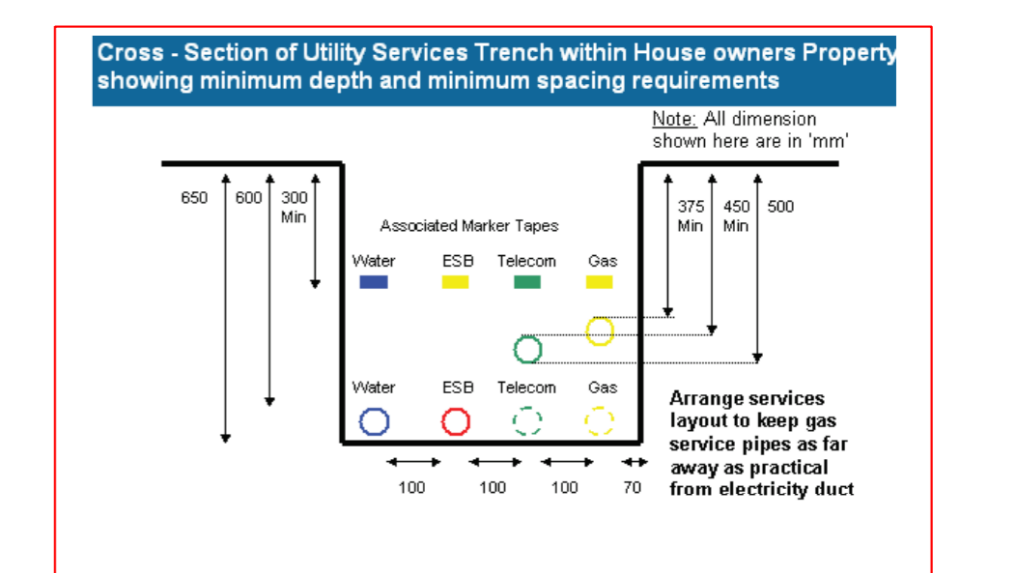

Unit Sub - Access Required

Rev	Description	Date	By
P1	Planning	15.12.20	BC
Rev	Description	Date	By

COFFEY CONSULTING ENGINEERING
 Unit 8, Forest Park, Mullingar, Co. Westmeath, Ireland
 Tel: +353 (0)44 93 10255 Mob: +353 (0)87 2280626
 Email: bcoffey@cceengineering.com Web: www.cceengineering.com

APPROVED: BC	CHECKED: BC	DRAWN: BC
Client: Galway County Council	Architect: VHA Architects	
Project: Moycullen Co. Galway	Address: 2A Deeppark Business Centre, Prospect Hill, Galway	
SCALE: 1:300 @ A1	JOB NO: 5156	DWG NO: P100

COPYRIGHT ©2019 Coffey Consulting Engineering
 No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of the Consultant as copyright holder except as agreed for use on the project for which the document was originally written.