



**Comhairle Chontae na Gaillimhe**  
**Galway County Council**

---

**Proposed Development of 1 No. Domestic Dwelling  
House & Associated Works at Woodfield, Dunmore,  
Co. Galway**

**EPA Site Suitability Assessment Report**

**November 2020**



**Jennings O'Donovan & Partners Ltd.,**  
Consulting Engineers, Finisklin Business Park, Sligo.  
Tel.: 071 916 1416 Fax: 071 916 1080  
e mail: [info@jodireland.com](mailto:info@jodireland.com)  
Web: [www.jodireland.com](http://www.jodireland.com)



**JENNINGS O'DONOVAN & PARTNERS LIMITED**  
*Project, Civil and Structural Consulting Engineers,*  
**FINISKLIN BUSINESS PARK,**  
**SLIGO,**  
**IRELAND.**



Telephone (071) 9161416  
 Fax (071) 9161080



Email [info@jodireland.com](mailto:info@jodireland.com)  
 Web Site [www.jodireland.com](http://www.jodireland.com)



## **DOCUMENT APPROVAL**

<b>PROJECT</b>	Proposed Development of 1 No. Domestic Dwelling House & Associated Works	
<b>CLIENT / JOB NO</b>	Galway County Council	6140
<b>DOCUMENT TITLE</b>	Site: Woodfield, Dunmore, Co. Galway EPA Site Suitability Assessment Report	

Prepared by		Reviewed/Approved by
Document <b>DRAFT</b>	Name PJ Regan	Name Mark Forbes
Date July 2020	Signature 	Signature 

Prepared by		Reviewed/Approved by
Document <b>FINAL</b>	Name Brian Murphy	Name Mark Forbes
Date 20th Nov 2020	Signature 	Signature 

This document, and information or advice which it contains, is provided by JENNINGS O'DONOVAN & PARTNERS LIMITED solely for internal use and reliance by its Client in performance of JENNINGS O'DONOVAN & PARTNERS LIMITED's duties and liabilities under its contract with the Client. Any advice, opinions, or recommendations within this document should be read and relied upon only in the context of the document as a whole. The advice and opinions in this document are based upon the information made available to JENNINGS O'DONOVAN & PARTNERS LIMITED at the date of this document and on current standards, codes, technology and construction practices as at the date of this document. Following final delivery of this document to the Client, JENNINGS O'DONOVAN & PARTNERS LIMITED will have no further obligations or duty to advise the Client on any matters, including development affecting the information or advice provided in this document. This document has been prepared by JENNINGS O'DONOVAN & PARTNERS LIMITED in their professional capacity as Consulting Engineers. The contents of the document does not, in any way, purport to include any manner of legal advice or opinion. This document is prepared in accordance with the terms and conditions of JENNINGS O'DONOVAN & PARTNERS LIMITED contract with the Client. Regard should be had to those terms and conditions when considering and/or placing any reliance on this document. Should the Client wish to release this document to a Third Party for that party's reliance, JENNINGS O'DONOVAN & PARTNERS LIMITED may, at its discretion, agree to such release provided that:

- (a) JENNINGS O'DONOVAN & PARTNERS LIMITED written agreement is obtained prior to such release, and
- (b) By release of the document to the Third Party, that Third Party does not acquire any rights, contractual or otherwise, whatsoever against JENNINGS O'DONOVAN & PARTNERS LIMITED and JENNINGS O'DONOVAN & PARTNERS LIMITED, accordingly, assume no duties, liabilities or obligations to that Third Party, and
- (c) JENNINGS O'DONOVAN & PARTNERS LIMITED accepts no responsibility for any loss or damage incurred by the Client or for any conflict of JENNINGS O'DONOVAN & PARTNERS LIMITED's interests arising out of the Client's release of this document to the Third Party

**Directors:** D. Kiely, C. McCarthy  
**Regional Director:** A. Phelan  
**Consultants:** C. Birney, M. Gavin, R. Gillan

**Senior Associates:** R. Davis, S. Gilmartin, J. Healy, J. McElvaney, T. McGloin  
**Associates:** L. Brennan, S. Lee, S. Martyn, L. McCormack, S. Molloy  
**Company Reg No.** 149104 **VAT Reg. No.** IE6546504D



6140/510/03/PJR

**TABLE OF CONTENTS**

<b>1. INTRODUCTION.....</b>	<b>1</b>
<b>2. SITE CHARACTERISATION FORM.....</b>	<b>1</b>

**APPENDICES****Appendix A – Site Suitability Assessment - Supporting Maps****Appendix B - Site Suitability Assessment - Supporting Photographs****Appendix C - Site Suitability Assessment - Supporting Drawings****Appendix D - Site Suitability Assessment – Supporting Document relating to  
Proposed Effluent Treatment System**

**1. INTRODUCTION**

Jennings O'Donovan & Partners Limited (JOD) have been appointed by Galway County Council to carry out Site Suitability Assessment on several single rural dwelling sites at various locations in County Galway.

This report relates to Site at Woodfield, Dunmore, Co. Galway.

**2. SITE CHARACTERISATION FORM**

Please see overleaf completed Site Characterisation Form for Woodfield, Dunmore, Co. Galway in accordance with the EPA Code of Practice for Wastewater Treatment and Disposal Systems Serving Single Houses (p.e,<10).



## APPENDIX B: SITE CHARACTERISATION FORM

File Reference: 6140 Site No. 3

### 1.0 GENERAL DETAILS (From planning application)

Prefix: First Name: GALWAY COUNTY COUNCIL Surname:

Address:

WOODFIELD, DUNMORE, CO. GALWAY.

Site Location and Townland:

WOODFIELD, DUNMORE, CO. GALWAY.

Telephone No: N/A

Fax No: N/A

E-Mail: N/A

Maximum no. of Residents: 6

No. of Double Bedrooms: 2

No. of Single Bedrooms: 0

Proposed Water Supply: Mains ☒

Private Well/Borehole ☐

Group Well/Borehole ☐

### 2.0 GENERAL DETAILS (From planning application)

Soil Type, (Specify Type): AminDW

Aquifer Category: Regionally Important ☒ Rk Locally Important ☐ Poor ☐

Vulnerability: Extreme ☐ High ☐ Moderate ☐ Low ☒ High to Low ☐ Unknown ☐

Bedrock Type: CDOAKP - Oakport Limestone

Name of Public/Group Scheme Water Supply within 1 km: PUBLIC MAINS

Groundwater Protection Scheme (Y/N): Yes

Source Protection Area: SI ☐ SO ☐

Groundwater Protection Response: R1

Presence of Significant Sites

(Archaeological, Natural & Historical):

SAC - 000297, Lough Corrib 0.3k WEST  
Monument - SMR No. GA00836, Quarry 450m EAST

Past experience in the area:

Comments:

(Integrate the information above in order to comment on: the potential suitability of the site, potential targets at risk, and/or any potential site restrictions).

SITE SUITABILITY:-  
R1 ACCEPTABLE SUBJECT TO NORMAL GOOD PRACTICE,

POTENTIAL TARGETS AT RISK:-  
SURFACE WATER, GROUND WATER

**Note:** Only information available at the desk study stage should be used in this section.

### 3.0 ON-SITE ASSESSMENT

#### 3.1 Visual Assessment

Landscape Position:

Slope: Steep (>1:5) ☐ Shallow (1:5-1:20) ☐ Relatively Flat (<1:20) ☒

Surface Features within a minimum of 250m (Distance To Features Should Be Noted In Metres)

Houses:

Existing Land Use:

Vegetation Indicators:

Groundwater Flow Direction:

Ground Condition:

Site Boundaries:

Roads:

Outcrops (Bedrock And/Or Subsoil):

Surface Water Ponding:  Lakes:

Beaches/Shellfish:  Areas/Wetlands:

Karst Features:

Watercourse/Stream\*:

Drainage Ditches\*:

Springs / Wells\*:

#### Comments:

(Integrate the information above in order to comment on: the potential suitability of the site, potential targets at risk, the suitability of the site to treat the wastewater and the location of the proposed system within the site).

#### POTENTIAL TARGETS AT RISK:-

#### GROUND WATER

SITE APPEARS SUITABLE FOR A WASTEWATER TREATMENT AND DISPOSAL SYSTEM PROVIDING FAVOURABLE T / P IS ACHIEVABLE.

THERE ARE NO SITE RESTRICTIONS, RELATIVELY LARGE SITE/LANDHOLDING.

\*Note and record water level

### 3.2 Trial Hole (should be a minimum of 2.1m deep (3m for regionally important aquifers))

To avoid any accidental damage, a trial hole assessment or percolation tests should not be undertaken in areas, which are at or adjacent to significant sites (e.g. NHAs, SACs, SPAs, and/or Archaeological etc.), without prior advice from National Parks and Wildlife Service or the Heritage Service.

Depth of trial hole (m):

Depth from ground surface  
to bedrock (m) (if present):

Depth from ground surface  
to water table (m) (if present):

Depth of water ingress:  Rock type (if present):

Date and time of excavation:   Date and time of examination:

	Depth of P/T Test*	Soil/Subsoil Texture & Classification**	Plasticity and dilatancy***	Soil Structure	Density/ Compactness	Colour****	Preferential flowpaths
0.1 m	<input type="text"/>	medium bedded sandy SILT/CLAY	DILATANCY WITH DIFFICULTY	CRUMB	VERY SOFT	DARK BROWN	GRASS ROOTS TO -0.4M B.G.L.
0.2 m	<input type="text"/>						
0.3 m	<input type="text"/>						
0.4 m	<input type="text" value="P1,2,3"/>						
0.5 m	<input type="text"/>	thickly bedded slightly silty, gravelly SAND with medium spaced cobbles and widely spaced boulders	DILATANCY WITH DIFFICULTY	ANGULAR	STIFF	SANDY BROWN	Preferential flow paths:- GRAVELS, COBLES
0.6 m	<input type="text"/>						
0.7 m	<input type="text"/>						
0.8 m	<input type="text"/>						
0.9 m	<input type="text" value="T 1,2,3"/>						
1.0 m	<input type="text"/>						
1.1 m	<input type="text"/>						
1.2 m	<input type="text"/>						
1.3 m	<input type="text"/>						
1.4 m	<input type="text"/>						
1.5 m	<input type="text"/>						
1.6 m	<input type="text"/>						
1.7 m	<input type="text"/>						
1.8 m	<input type="text"/>						
1.9 m	<input type="text"/>						
2.0 m	<input type="text"/>						
2.1 m	<input type="text"/>	TRIAL HOLE	TRIAL HOLE	TRIAL HOLE	TRIAL HOLE	TRIAL HOLE	TRIAL HOLE
2.2 m	<input type="text"/>	TO 2.1m B.G.LEVEL	TO 2.1m B.G.L	2.1m B.G.L	TO 2.1m B.G.L	2.1m B.G.L	TO 2.1m B.G.L
2.3 m	<input type="text"/>						
2.4 m	<input type="text"/>						
2.5 m	<input type="text"/>						
2.6 m	<input type="text"/>						
2.7 m	<input type="text"/>						
2.8 m	<input type="text"/>						
2.9 m	<input type="text"/>						
3.0 m	<input type="text"/>						

Likely T value:

**Note:** \*Depth of percolation test holes should be indicated on log above. (Enter P or T at depths as appropriate).

\*\* See Appendix E for BS 5930 classification.

\*\*\* 3 samples to be tested for each horizon and results should be entered above for each horizon.

\*\*\*\* All signs of mottling should be recorded.

### 3.2 Trial Hole (contd.) Evaluation:

The Trial pit shows 0.2m upper layer of sandy SILT/CLAY Topsoil and a thickly bedded slightly silty, gravely SAND subsoil layer directly under the topsoil to 2.1m below ground level with medium spaced cobbles and widely spaced boulders.

The soil and subsoil layers are likely to produce favorable percolation rates for the 'P' & 'T' tests.

The trial pit was excavated to a depth of 2.1m below ground. There were significant boulders noted to the base of the trial pit at time of excavation. There was no water ingress and no water table noted within the trial pit.

### 3.3(a) Percolation ("T") Test for Deep Subsoils and/or Water Table

#### Step 1: Test Hole Preparation

##### Percolation Test Hole

	1	2	3
Depth from ground surface to top of hole (mm) (A)	550	550	550
Depth from ground surface to base of hole (mm) (B)	950	950	950
Depth of hole (mm) [B - A]	400	400	400
Dimensions of hole [length x breadth (mm)]	300 x 300	300 x 300	300 x 300

#### Step 2: Pre-Soaking Test Holes

Date and Time pre-soaking started	05/07/2020	09:04	05/07/2020	09:07	05/07/2020	09:10
-----------------------------------	------------	-------	------------	-------	------------	-------

Each hole should be pre-soaked twice before the test is carried out. Each hole should be empty before refilling.

#### Step 3: Measuring $T_{100}$

##### Percolation Test Hole No.

	1	2	3
Date of test	06/07/2020	06/07/2020	06/07/2020
Time filled to 400 mm	12:43	12:44	12:45
Time water level at 300 mm	12:47	12:56	13:51
Time to drop 100 mm ( $T_{100}$ )	4.00	12.00	66.00
Average $T_{100}$			27.33

If  $T_{100} > 300$  minutes then T-value  $>90$  – site unsuitable for discharge to ground

If  $T_{100} \leq 210$  minutes then go to Step 4;

If  $T_{100} > 210$  minutes then go to Step 5;

**Step 4:** Standard Method (where  $T_{100} \leq 210$  minutes)

Percolation Test Hole	1			2			3		
Fill no.	Start Time (at 300 mm)	Finish Time (at 200 mm)	$\Delta t$ (min)	Start Time (at 300 mm)	Finish Time (at 200 mm)	$\Delta t$ (min)	Start Time (at 300 mm)	Finish Time (at 200 mm)	$\Delta t$ (min)
1	12:47	12:59	12.00	12:56	13:22	26.00	13:51	15:50	119.00
2	12:59	13:21	22.00	13:22	14:04	42.00	15:50	18:52	182.00
3	13:21	13:39	18.00	14:04	14:39	35.00	18:52	23:38	286.00
Average $\Delta t$ Value			17.33			34.33			195.67
	Average $\Delta t/4 =$ [Hole No.1] 4.33 ( $t_1$ )			Average $\Delta t/4 =$ [Hole No.2] 8.58 ( $t_2$ )			Average $\Delta t/4 =$ [Hole No.3] 48.92 ( $t_3$ )		

Result of Test:  $T =$  20.61 (min/25 mm)

Comments:

THE RESULT OF THE 'T' TEST CARRIED OUT ON SITE INDICATE THAT THE SITE IS SUITABLE FOR A SEPTIC TANK SYSTEM OR A SECONDARY TREATMENT SYSTEM WITH A POLISHING FILTER DISCHARGING TO GROUNDWATER.

**Step 5:** Modified Method (where  $T_{100} > 210$  minutes)

Percolation Test Hole No.	1				2				3			
Fall of water in hole (mm)	Time Factor = $T_f$	Time of fall (mins) = $T_m$	$K_{fs} = T_f / T_m$	T – Value = 4.45 / $K_{fs}$	Time Factor = $T_f$	Time of fall (mins) = $T_m$	$K_{fs} = T_f / T_m$	T – Value = 4.45 / $K_{fs}$	Time Factor = $T_f$	Time of fall (mins) = $T_m$	$K_{fs} = T_f / T_m$	T – Value = 4.45 / $K_{fs}$
300 - 250	8.1				8.1				8.1			
250 - 200	9.7				9.7				9.7			
200 - 150	11.9				11.9				11.9			
150 - 100	14.1				14.1				14.1			
Average T- Value	T- Value Hole 1= ( $t_1$ ) 0.00				T- Value Hole 1= ( $t_2$ ) 0.00				T- Value Hole 1= ( $t_3$ ) 0.00			

Result of Test:  $T =$  0.00 (min/25 mm)

Comments:

### 3.3(b) Percolation ("P") Test for Shallow Soil / Subsoils and/or Water Table

#### Step 1: Test Hole Preparation

Percolation Test Hole	1	2	3
Depth from ground surface to top of hole (mm)	0	0	0
Depth from ground surface to base of hole (mm)	400	400.00	400
Depth of hole (mm)	400	400	400
Dimensions of hole [length x breadth (mm)]	300 x 300	300 x 300	300 x 300

#### Step 2: Pre-Soaking Test Holes

Date and Time pre-soaking started	05/07/2020	09:12	05/07/2020	09:13	05/07/2020	09:16
-----------------------------------	------------	-------	------------	-------	------------	-------

Each hole should be pre-soaked twice before the test is carried out. Each hole should be empty before refilling.

#### Step 3: Measuring $P_{100}$

Percolation Test Hole No.	1	2	3
Date of test	06/07/2020	06/07/2020	06/07/2020
Time filled to 400 mm	12:38	12:40	12:40
Time water level at 300 mm	12:43	12:47	12:43
Time to drop 100 mm ( $P_{100}$ )	5.00	7.00	3.00
Average $P_{100}$			5.00

If  $P_{100} > 300$  minutes then P-value  $>90$  – site unsuitable for discharge to ground

If  $P_{100} \leq 210$  minutes then go to Step 4;

If  $P_{100} > 210$  minutes then go to Step 5;

**Step 4: Standard Method** (where  $P_{100} \leq 210$  minutes)

Percolation Test Hole	1			2			3		
Fill no.	Start Time (at 300 mm)	Finish Time (at 200 mm)	$\Delta p$ (min)	Start Time (at 300 mm)	Finish Time (at 200 mm)	$\Delta p$ (min)	Start Time (at 300 mm)	Finish Time (at 200 mm)	$\Delta p$ (min)
1	12:43	12:58	15.00	12:47	13:20	33.00	12:43	12:49	6.00
2	12:58	13:18	20.00	13:20	14:03	43.00	12:49	12:57	8.00
3	13:18	13:40	22.00	14:03	15:03	60.00	12:57	13:05	8.00
Average $\Delta p$ Value			19.00			45.33			7.33
	Average $\Delta p/4 =$ [Hole No.1] 4.75 ( $p_1$ )			Average $\Delta p/4 =$ [Hole No.2] 11.33 ( $p_2$ )			Average $\Delta p/4 =$ [Hole No.3] 1.83 ( $p_3$ )		

Result of Test:  $P =$  5.97 (min/25 mm)

Comments:

THE RESULT OF THE 'P' TEST CARRIED OUT ON SITE INDICATE THE UPPER SOIL LAYER IS SUITABLE FOR A SECONDARY TREATMENT SYSTEM WITH POLISHING FILTER AT GROUND SURFACE OR OVERGROUND.

**Step 5: Modified Method** (where  $P_{100} > 210$  minutes)

Percolation Test Hole No.	1				2				3			
Fall of water in hole (mm)	Time Factor $= T_f$	Time of fall (mins) $= T_m$	$K_{fs} = T_f / T_m$	P – Value $= 4.45 / K_{fs}$	Time Factor $= T_f$	Time of fall (mins) $= T_m$	$K_{fs} = T_f / T_m$	P – Value $= 4.45 / K_{fs}$	Time Factor $= T_f$	Time of fall (mins) $= T_m$	$K_{fs} = T_f / T_m$	P – Value $= 4.45 / K_{fs}$
300 - 250	8.1				8.1				8.1			
250 - 200	9.7				9.7				9.7			
200 - 150	11.9				11.9				11.9			
150 - 100	14.1				14.1				14.1			
Average P- Value	P- Value Hole 1= ( $p_1$ ) 0.00				P- Value Hole 1= ( $p_2$ ) 0.00				P- Value Hole 1= ( $p_3$ ) 0.00			

Result of Test:  $P =$  0.00 (min/25 mm)

Comments:

**3.4 The following associated Maps, Drawings and Photographs should be appended to this site characterisation form.**

1. Discovery Series 1:50,000 Map indicating overall drainage, groundwater flow direction and housing density in the area.
2. Supporting maps for vulnerability, aquifer classification, soil, bedrock.
3. North point should always be included.
4. (a) Sketch of site showing measurements to Trial Hole location and  
(b) Percolation Test Hole locations,  
(c) wells and  
(d) direction of groundwater flow (if known),  
(e) proposed house (incl. distances from boundaries)  
(f) adjacent houses,  
(g) watercourses,  
(h) significant sites  
(i) and other relevant features.
5. Cross sectional drawing of the site and the proposed layout<sup>1</sup> should be submitted.
6. Photographs of the trial hole, test holes and site (date and time referenced).

<sup>1</sup> The calculated percolation area or polishing filter area should be set out accurately on the site layout drawing in accordance with the code of practice's requirements.



## 4.0 CONCLUSION of SITE CHARACTERISATION

Integrate the information from the desk study and on-site assessment (i.e. visual assessment, trial hole and percolation tests) above and conclude the type of system(s) that is (are) appropriate. This information is also used to choose the optimum final disposal route of the treated wastewater.

Not Suitable for Development

☐

### Suitable for <sup>1</sup>

1. Septic tank system (septic tank and percolation area)

Yes

2. Secondary Treatment System

a. septic tank and filter system constructed on-site and polishing filter; or

Yes

b. packaged wastewater treatment system and polishing filter

Yes

### Discharge Route

Discharge to Ground Water

## 5.0 RECOMMENDATION

Propose to install:

Packaged wastewater treatment system and polishing filter

and discharge to:

Ground Water

Trench Invert level (m):

-0.85

Site Specific Conditions (e.g. special works, site improvement works testing etc.

DUE TO SITE RESTRICTIONS REGARDING SEPERATION DISTANCE REQUIRMENTS, IT IS RECOMMENDED TO INSTALL A SECONDARY EFFLUENT TREATMENT SYSTEM FOLLOWED BY A POLISHING FILTER - TRENCH INVERT AT -0.85m BELOW GROUND LEVEL (AS PER SITE LAYOUT PLAN & SECTION A-A THROUGH POLISHING FILTER drawing number 6140-JOD-XX-ZZ-DR-B-2022 & 2023 (A3 @ 1:500, 1:100))

#### SECONDARY TREATMENT SYSTEM:-

THE PACKAGED WASTEWATER TREATMENT SYSTEM SHALL BE IN ACCORDANCE THE REQUIREMENTS OUTLINED IN THE EPA CODE OF PRACTICE - WASTEWATER TREATMENT AND DISPOSAL SYSTEMS SERVING SINGLE HOUSES 2009 AND SHALL BE CERTIFIED IN ACCORDANCE WITH EN12566-3.

#### POLISHING FILTER:-

THE POLISHING FILTER SHALL BE INSTALLED AS PER SITE LAYOUT PLAN, SECTION A-A THROUGH POLISHING FILTER drawing number 6140-JOD-XX-ZZ-DR-B-2022 & 2023 (A3 @ 1:500, 1:100) i.e. INSTALL A DISTRUBTION BOX WITH 4 No. 9m RUNS OF 110mm uPVC PIPEWORK AT GROUND LEVEL, LAID AT A 1:200 GRADIENT, WITH 8mm PERFORATIONS (TYPICALLY AT 4,6,8 o'clock) AT 75mm CENTRES, PIPE WORK TO BE LAID 2.5M CENTER TO CENTER WITHIN A 500mm WIDE TRENCH ON 300MM DEEP 8-32mm WASHED GRAVEL AND 150MM WASHED GRAVEL OVER PIPEWORK WITH GEOTEXTILE MEMBRANE OVER GRAVEL AND 300mm DEEP TOPSOIL COVER OVER GEOTEXTILE.

<sup>1</sup> note: more than one option may be suitable for a site and this should be recorded

<sup>2</sup> A discharge of sewage effluent to "waters" (definition includes any or any part of any river, stream, lake, canal, reservoir, aquifer, pond, watercourse or other inland waters, whether natural or artificial) will require a licence under the Water Pollution Acts 1977-90. Refer to Section 2.6.2.

## 6.0 TREATMENT SYSTEM DETAILS

### SYSTEM TYPE: Septic Tank System

Tank Capacity (m <sup>3</sup> )	<input type="text"/>	Percolation Area		Mounded Percolation Area	
		No. of Trenches	<input type="text"/>	No. of Trenches	<input type="text"/>
		Length of Trenches (m)	<input type="text"/>	Length of Trenches (m)	<input type="text"/>
		Invert Level (m)	<input type="text"/>	Invert Level (m)	<input type="text"/>

### SYSTEM TYPE: Secondary Treatment System

#### Filter Systems

Media Type	Area (m <sup>2</sup> )*	Depth of Filter	Invert Level
Sand/Soil	<input type="text"/>	<input type="text"/>	<input type="text"/>
Soil	<input type="text"/>	<input type="text"/>	<input type="text"/>
Constructed Wetland	<input type="text"/>	<input type="text"/>	<input type="text"/>
Other	<input type="text"/>	<input type="text"/>	<input type="text"/>

#### Package Treatment Systems

Type	<input type="text" value="SOLIDO SMART - S.B.R."/>
Capacity PE	<input type="text" value="6.00"/>
Sizing of Primary Compartment	<input type="text" value="3.00"/> m <sup>3</sup>

### SYSTEM TYPE: Tertiary Treatment System

<b>Polishing Filter:</b> Surface Area (m <sup>2</sup> )*	<input type="text" value="67.50"/>	<b>Package Treatment System:</b> Capacity (pe)	<input type="text"/>
<b>or Gravity Fed:</b>		<b>Constructed Wetland:</b> Surface Area (m <sup>2</sup> )*	<input type="text"/>
No. of Trenches	<input type="text" value="4"/>		
Length of Trenches (m)	<input type="text" value="9.00"/>		
Invert Level (m)	<input type="text" value="-0.80"/>		

### DISCHARGE ROUTE:

Groundwater	<input checked="" type="checkbox"/>	Hydraulic Loading Rate * (l/m <sup>2</sup> .d)	<input type="text"/>
Surface Water **	<input type="checkbox"/>	Discharge Rate (m <sup>3</sup> /hr)	<input type="text"/>

### TREATMENT STANDARDS:

Treatment System Performance Standard (mg/l)	BOD	SS	NH <sub>4</sub> - N	Total N	Total P
EN 12566-3	<input type="text" value="5.00"/>	<input type="text" value="13.00"/>	<input type="text" value="0.70"/>	<input type="text" value="5.00"/>	<input type="text" value="2.00"/>

### QUALITY ASSURANCE:

#### Installation & Commissioning

THE PACKAGED SYSTEM AND POLISHING FILTER SHALL BE INSTALLED IN ACCORDANCE THE REQUIREMENTS OUTLINED IN THE EPA CODE OF PRACTICE - WASTEWATER TREATMENT AND DISPOSAL SYSTEMS SERVING SINGLE HOUSES 2009. COMMISSIONING BY MANUFACTURES REPRESENTATIVE.

#### On-going Maintenance

DE-SLUDGING SHALL BE CARRIED OUT A MINIMUM OF ONCE PER YEAR AND IN ACCORDANCE THE REQUIREMENTS OUTLINED IN THE EPA CODE OF PRACTICE - WASTEWATER TREATMENT AND DISPOSAL SYSTEMS SERVING SINGLE HOUSES 2009.

\* Hydraulic loading rate is determined by the percolation rate of subsoil

\*\* Water Pollution Act discharge licence required

## 7.0 SITE ASSESSOR DETAILS

Company: JENNINGS O'DONOVAN & PARTNERS

Prefix: Mr. First Name: PJ Surname: REGAN

Address: FINISKLIN, SLIGO, CO. SLIGO.

Qualifications/Experience: B. Sc. (Bld. Surv), FETAC Site Suitability Assessment

Date of Report: 20/07/2020

Phone: 071 9161416 Fax: e-mail: pjregan@jodireland.com


Indemnity Insurance Number:


Signature:  \_\_\_\_\_

# **APPENDIX A**


## **SITE SUITABILITY ASSESSMENT SUPPORTING MAPS**


- Soil Classification Map
- Aquifer Classification Map
  - Vulnerability Map
  - Bedrock Map
  - Karst Map
- Wells & Springs Map
- National Parks & Wildlife Map
- National Monuments Map

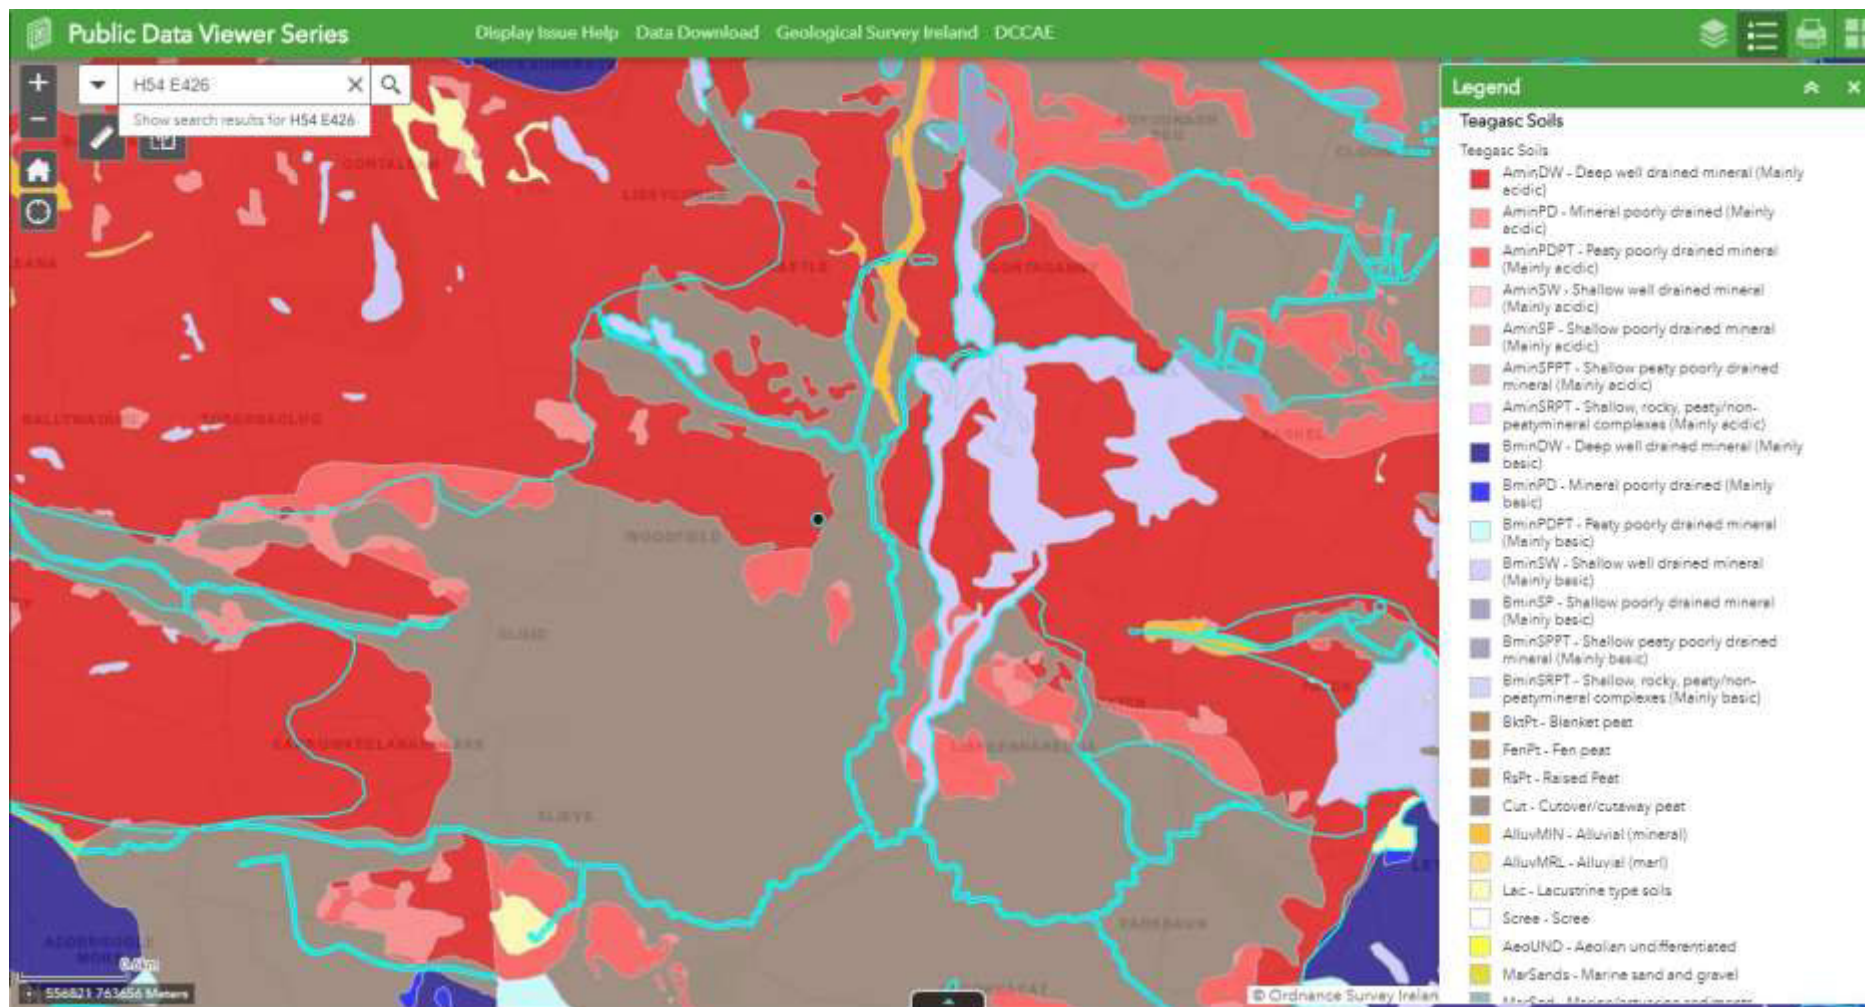

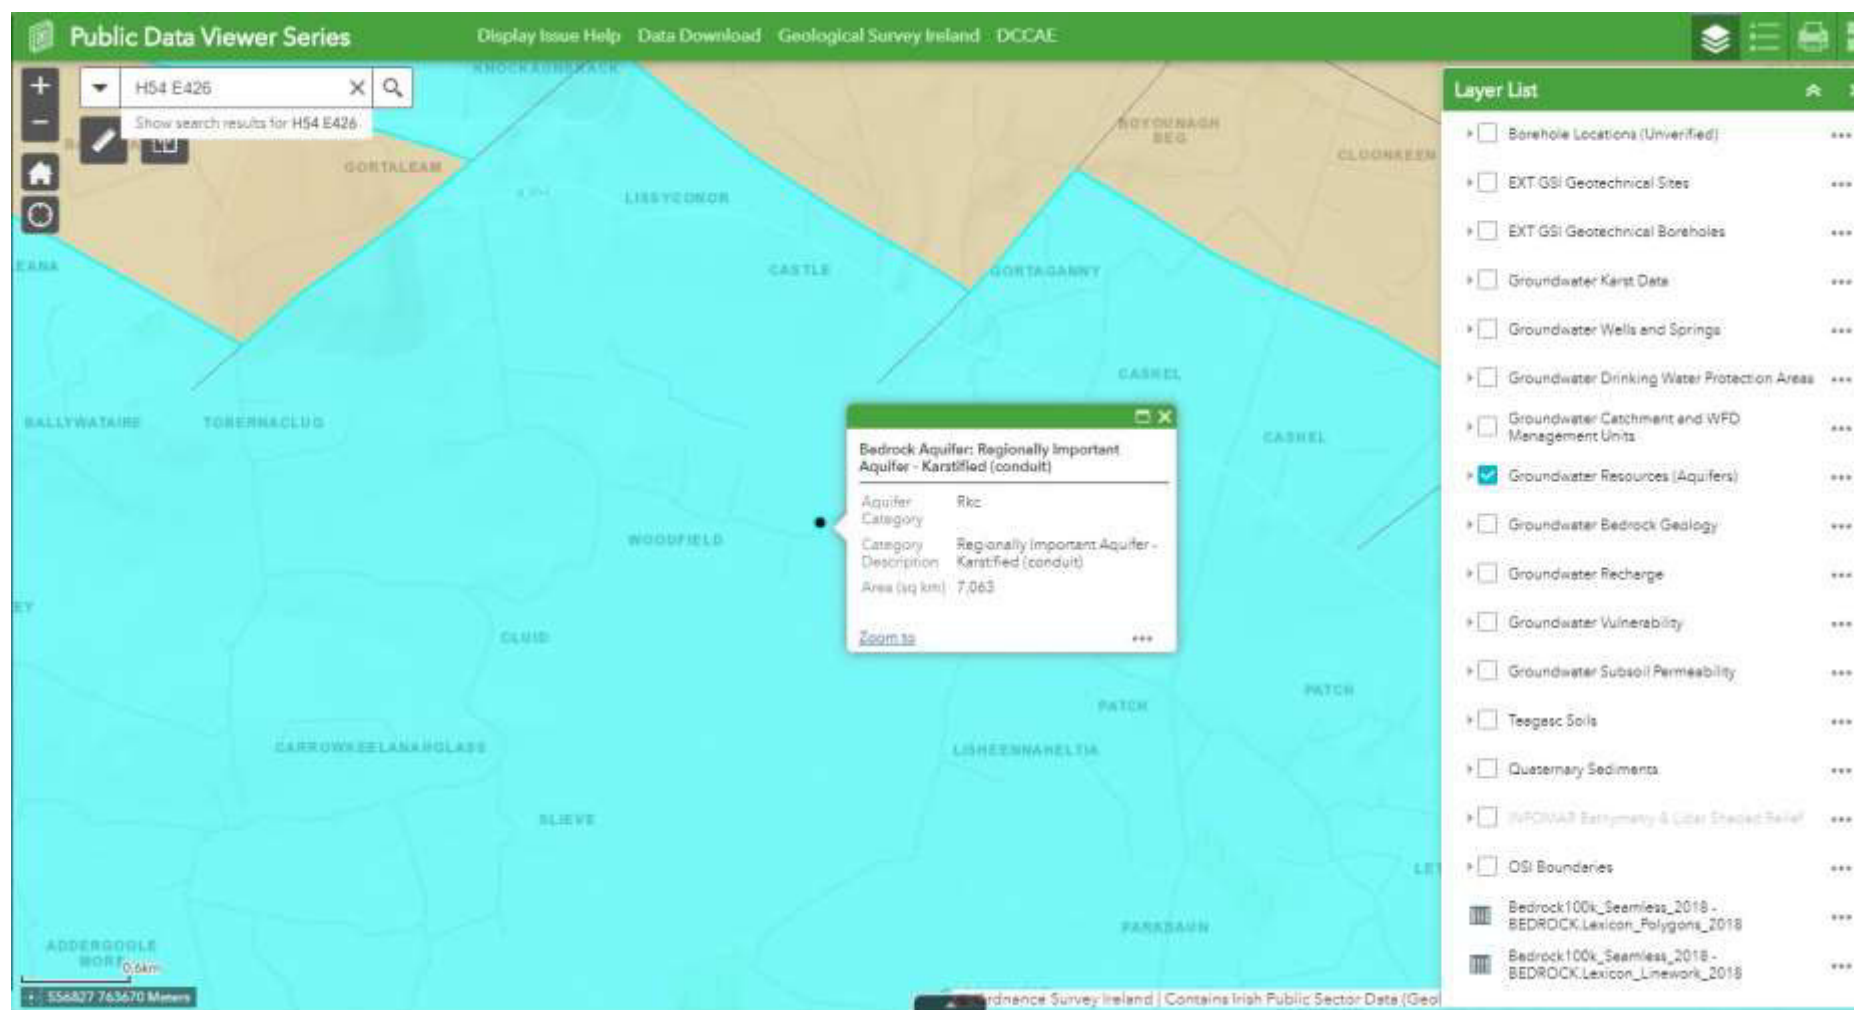




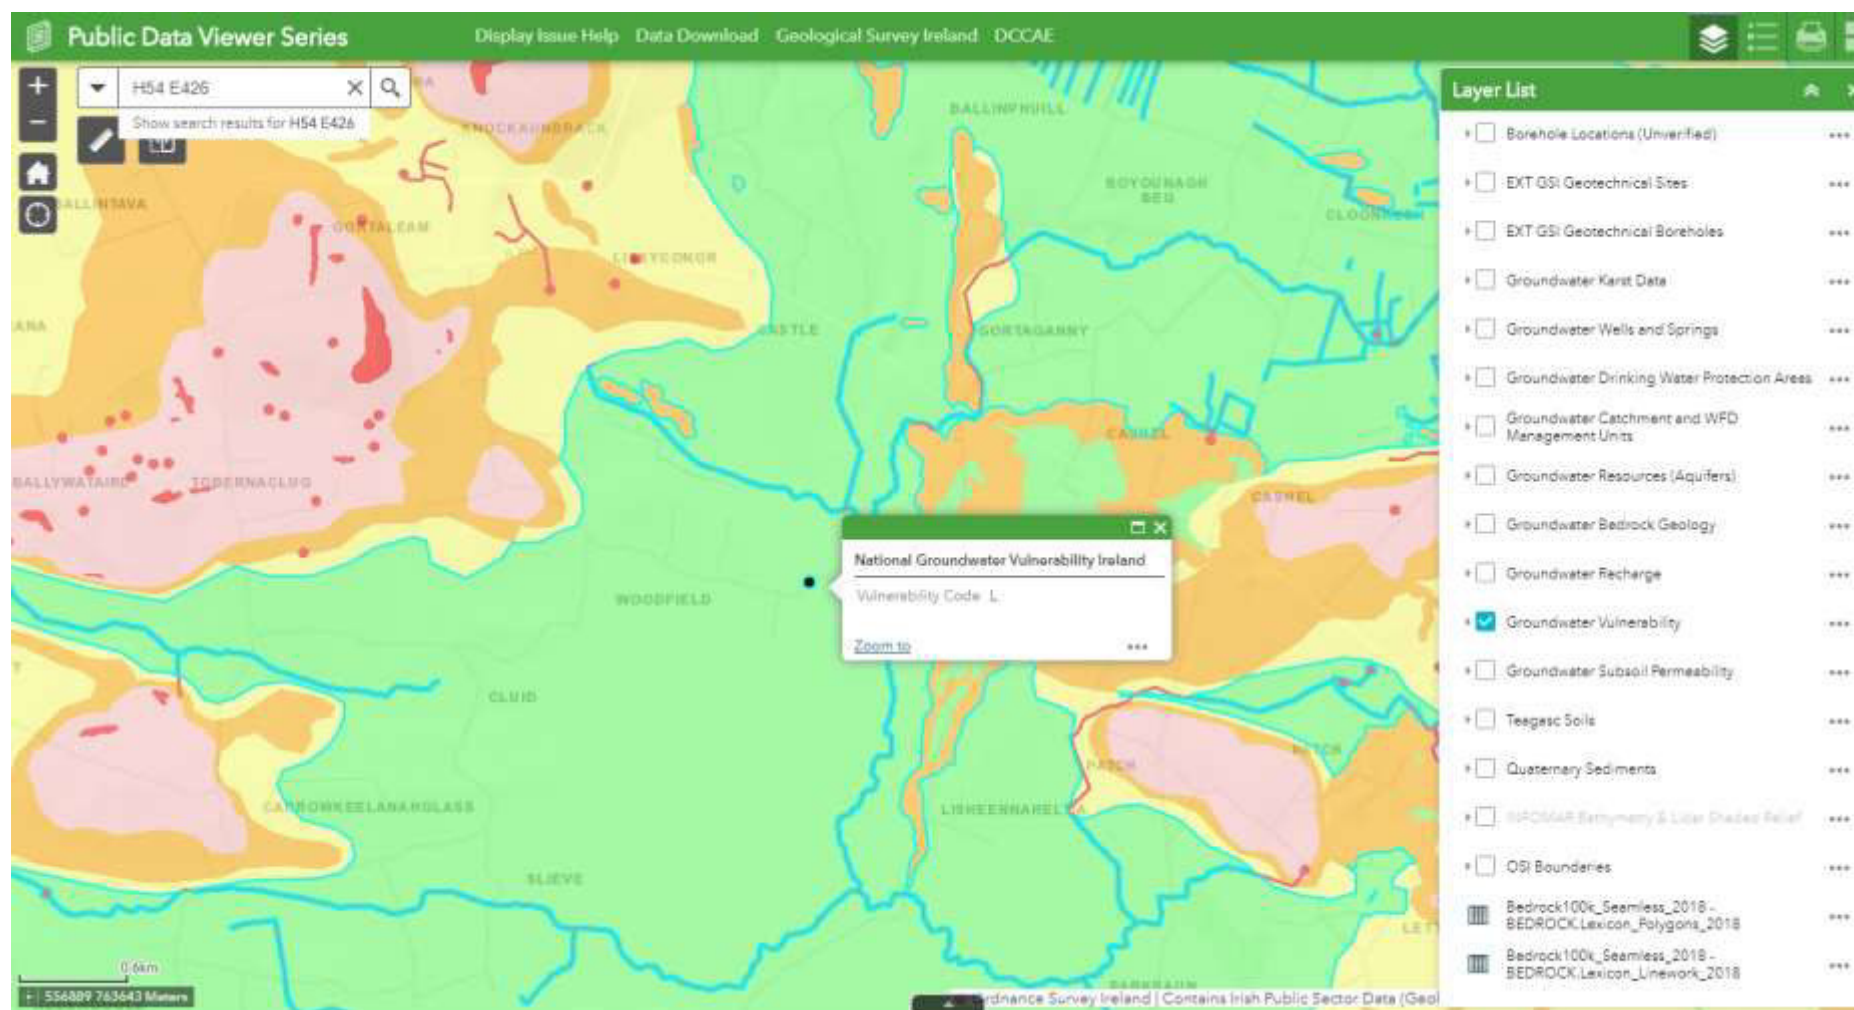


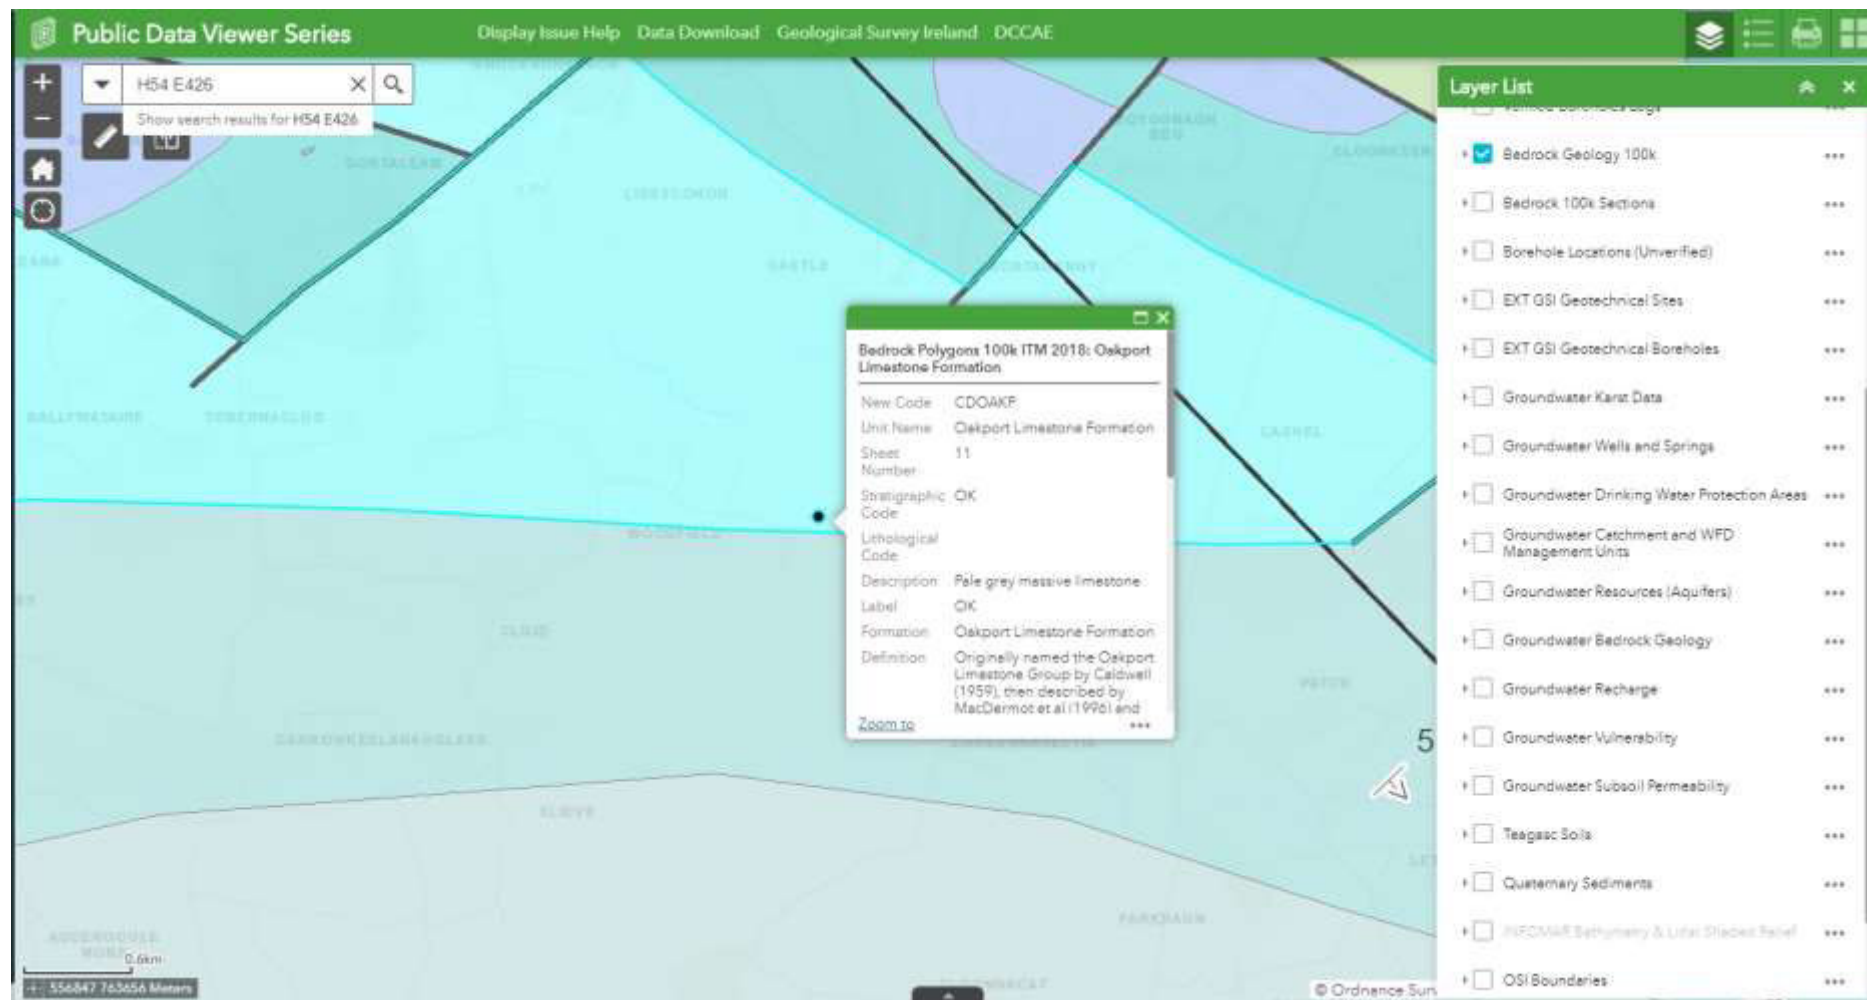




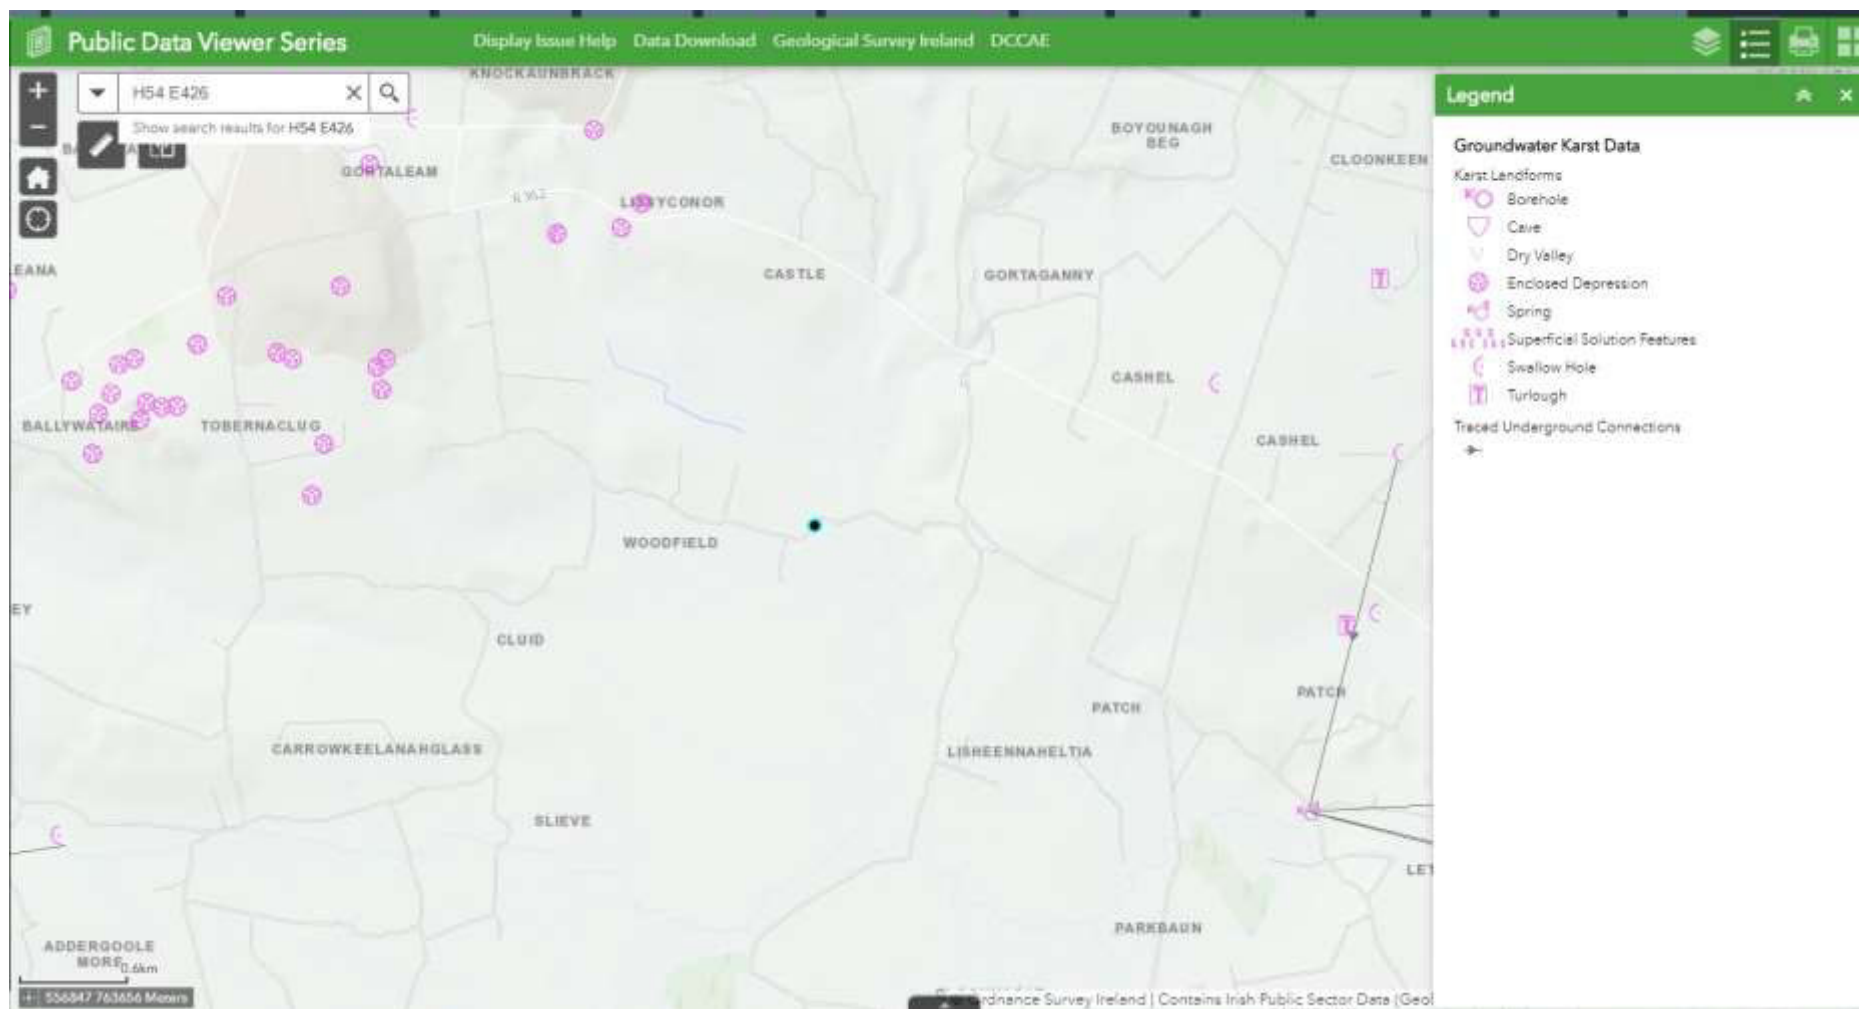


Karst Features Map

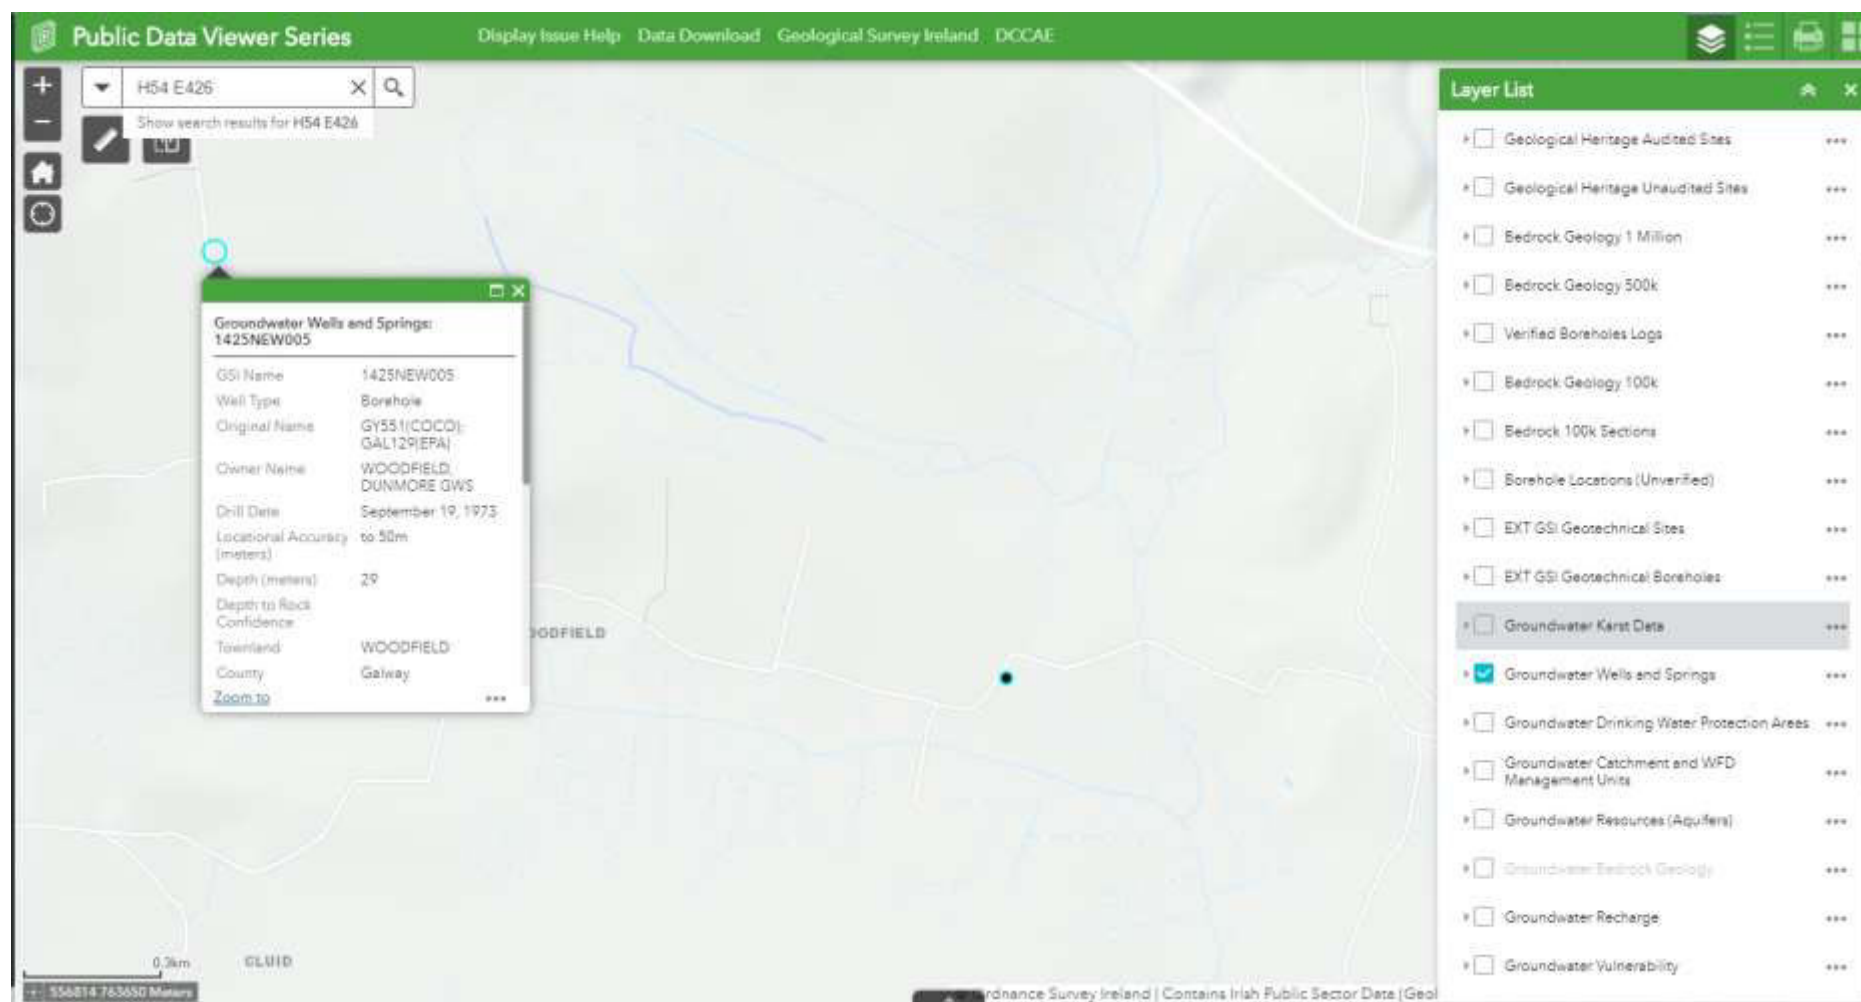

Wells & Springs Map

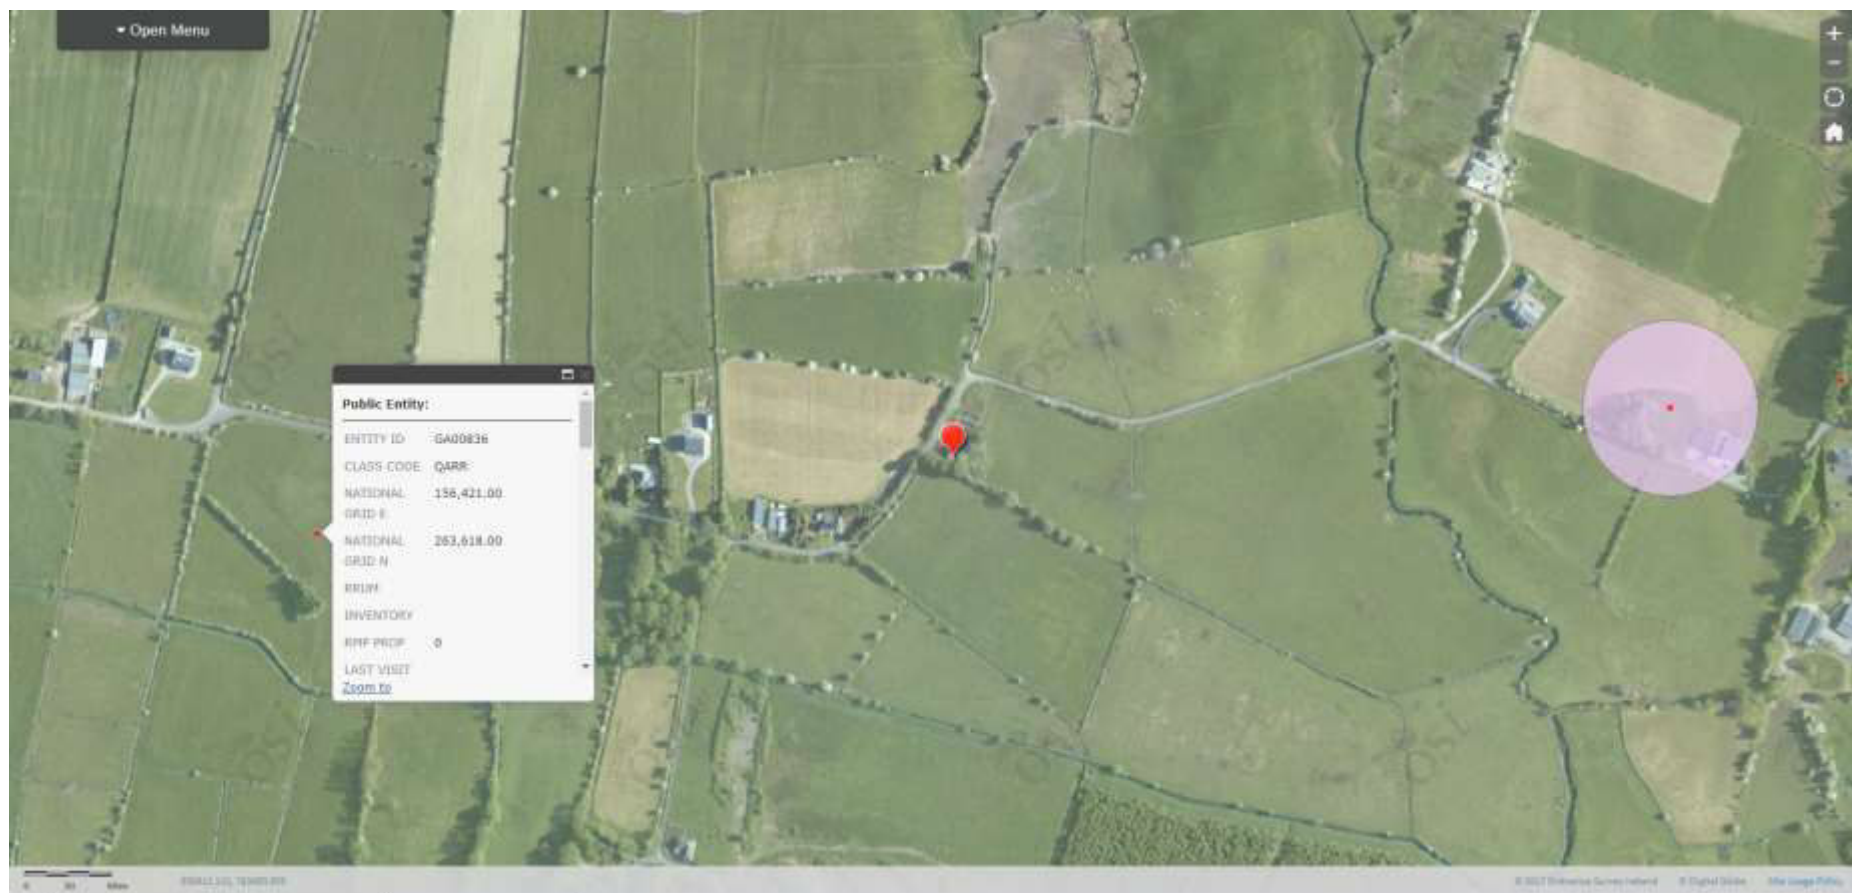

National Monuments Map

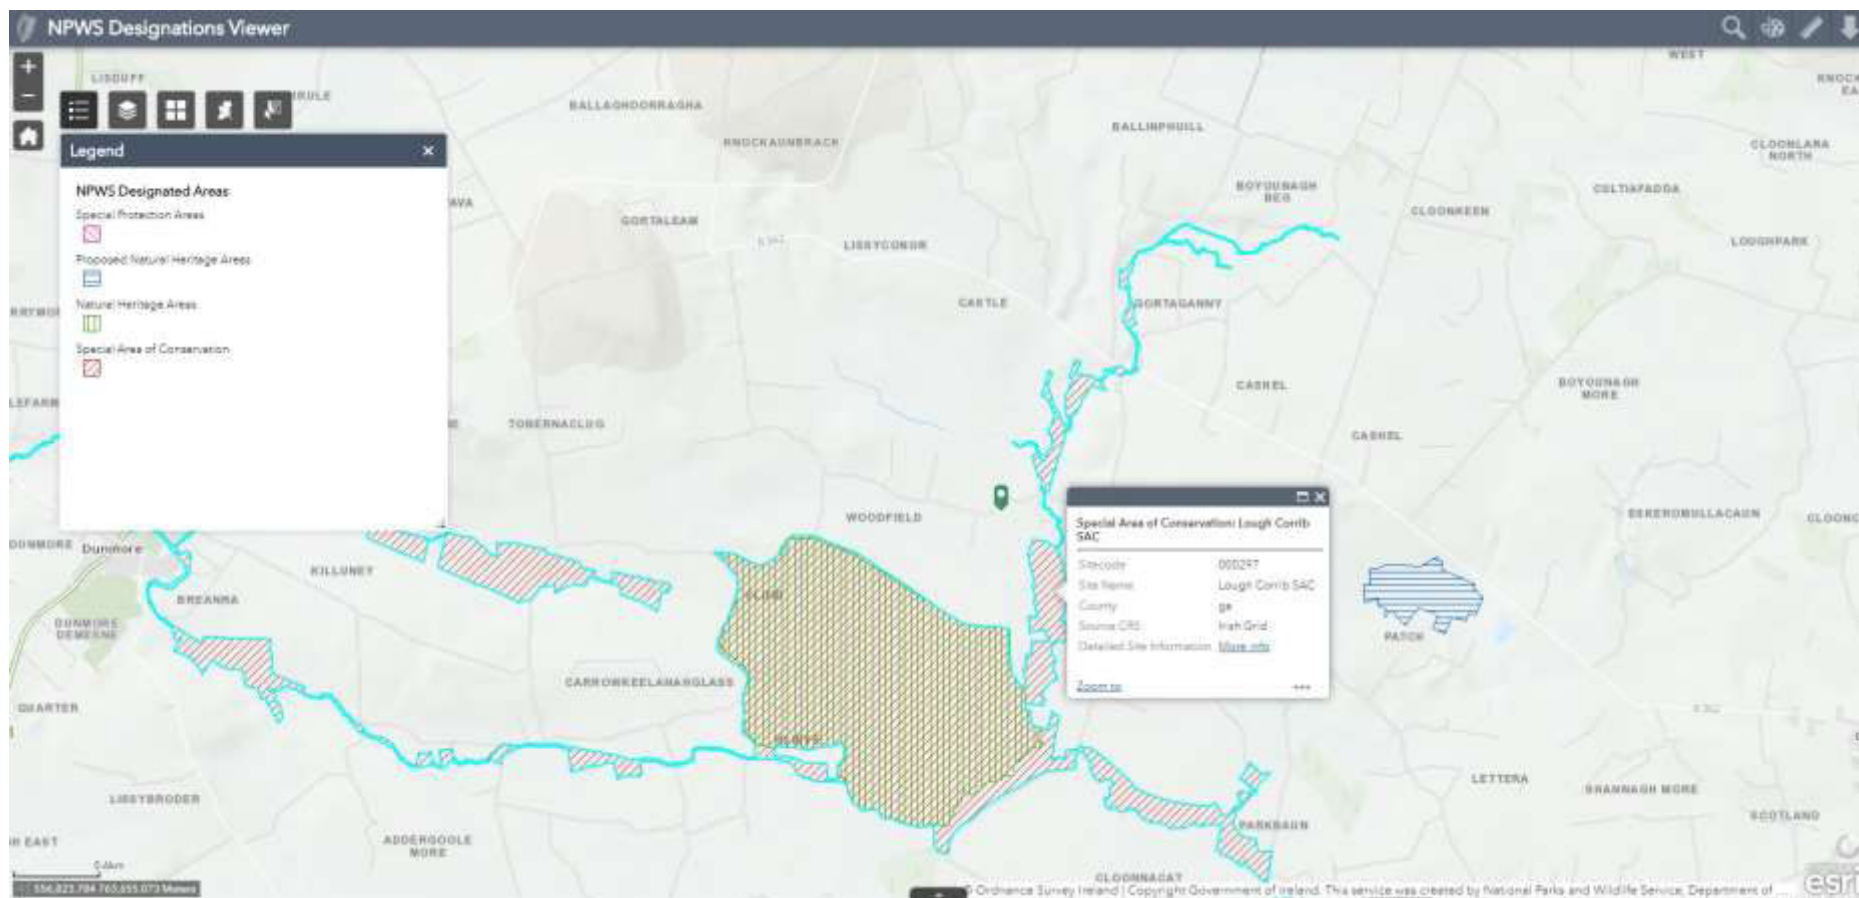


## **APPENDIX B**

### **SITE SUITABILITY ASSESSMENT SUPPORTING PHOTOGRAPHS**

- Overview of site
  - Trial Hole
    - P Tests
    - T Tests



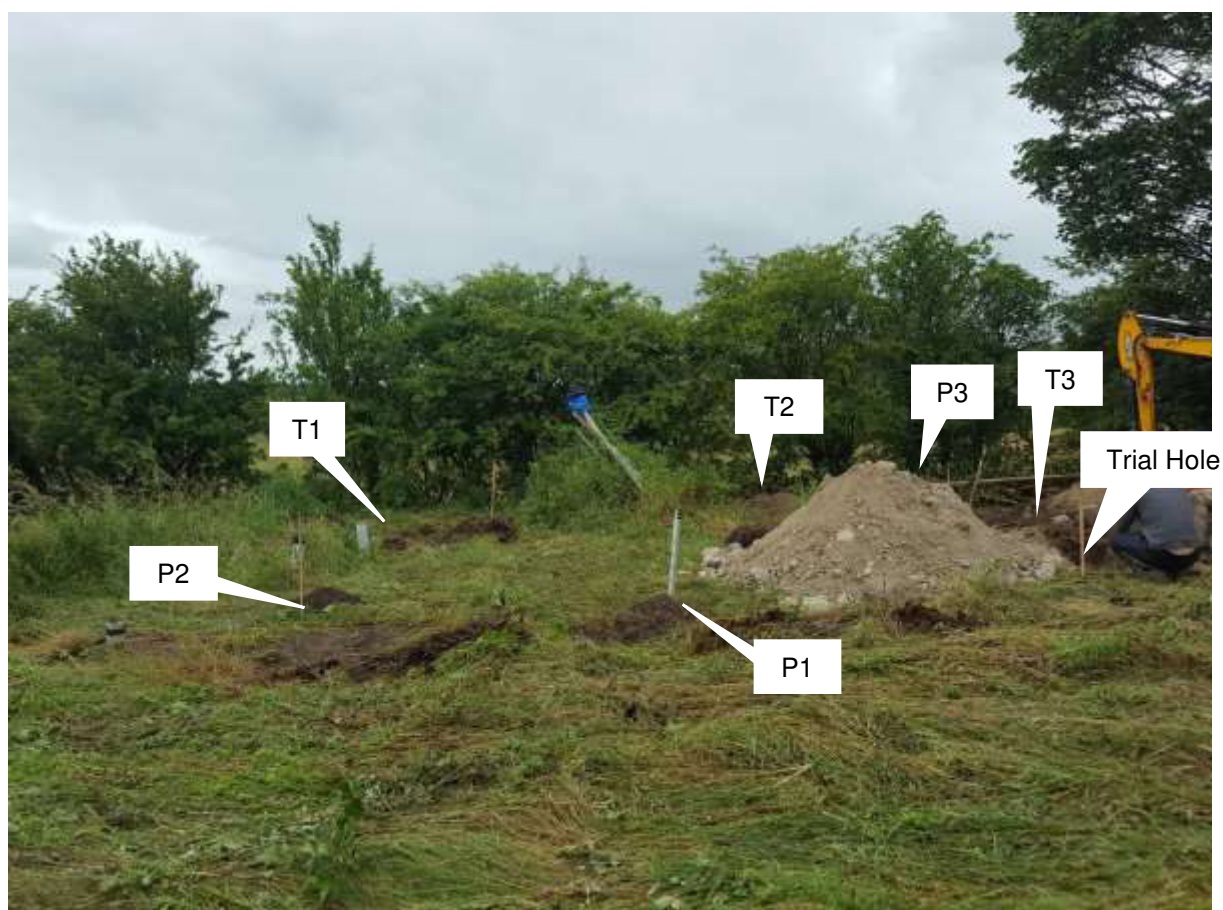

Overview of percolation test area, showing Trial Pit, T & P text holes.



Trial Pit dug to 2.1m deep 05-07-2020.



Trial Pit dug to 2.1m deep 05-07-2020.



Trial Pit spoil dug to 2.1m deep 05-07-2020.





P1 dug to 400mm 05-07-2020



P1 dug to 400mm 05-07-2020





P2 dug to 400mm 05-07-2020



P2 dug to 400mm 05-07-2020





P3 dug to 400mm 05-07-2020



P3 dug to 400mm 02-07-2020



T1 dug to 400mm 05-07-2020



T1 dug to 400mm 05-07-2020





T2 dug to 400mm 05-07-2020



T2 dug to 400mm 05-07-2020



T3 dug to 400mm 05-07-2020




T3 dug to 400mm 05-07-2020

## **APPENDIX C**

### **SITE SUITABILITY ASSESSMENT SUPPORTING DRAWINGS**

- 6140-JOD-XX-ZZ-DR-B-2019 - Site Identification Map.
  - 6140-JOD-XX-ZZ-DR-B-2020 - Site Location Map.
- 6140-JOD-XX-ZZ-DR-B-2021 - Existing Site Layout Plan
- 6140-JOD-XX-ZZ-DR-B-2022 - Proposed Site Layout Plan
- 6140-JOD-XX-ZZ-DR-B-2023 – Polishing Filter Section A-A



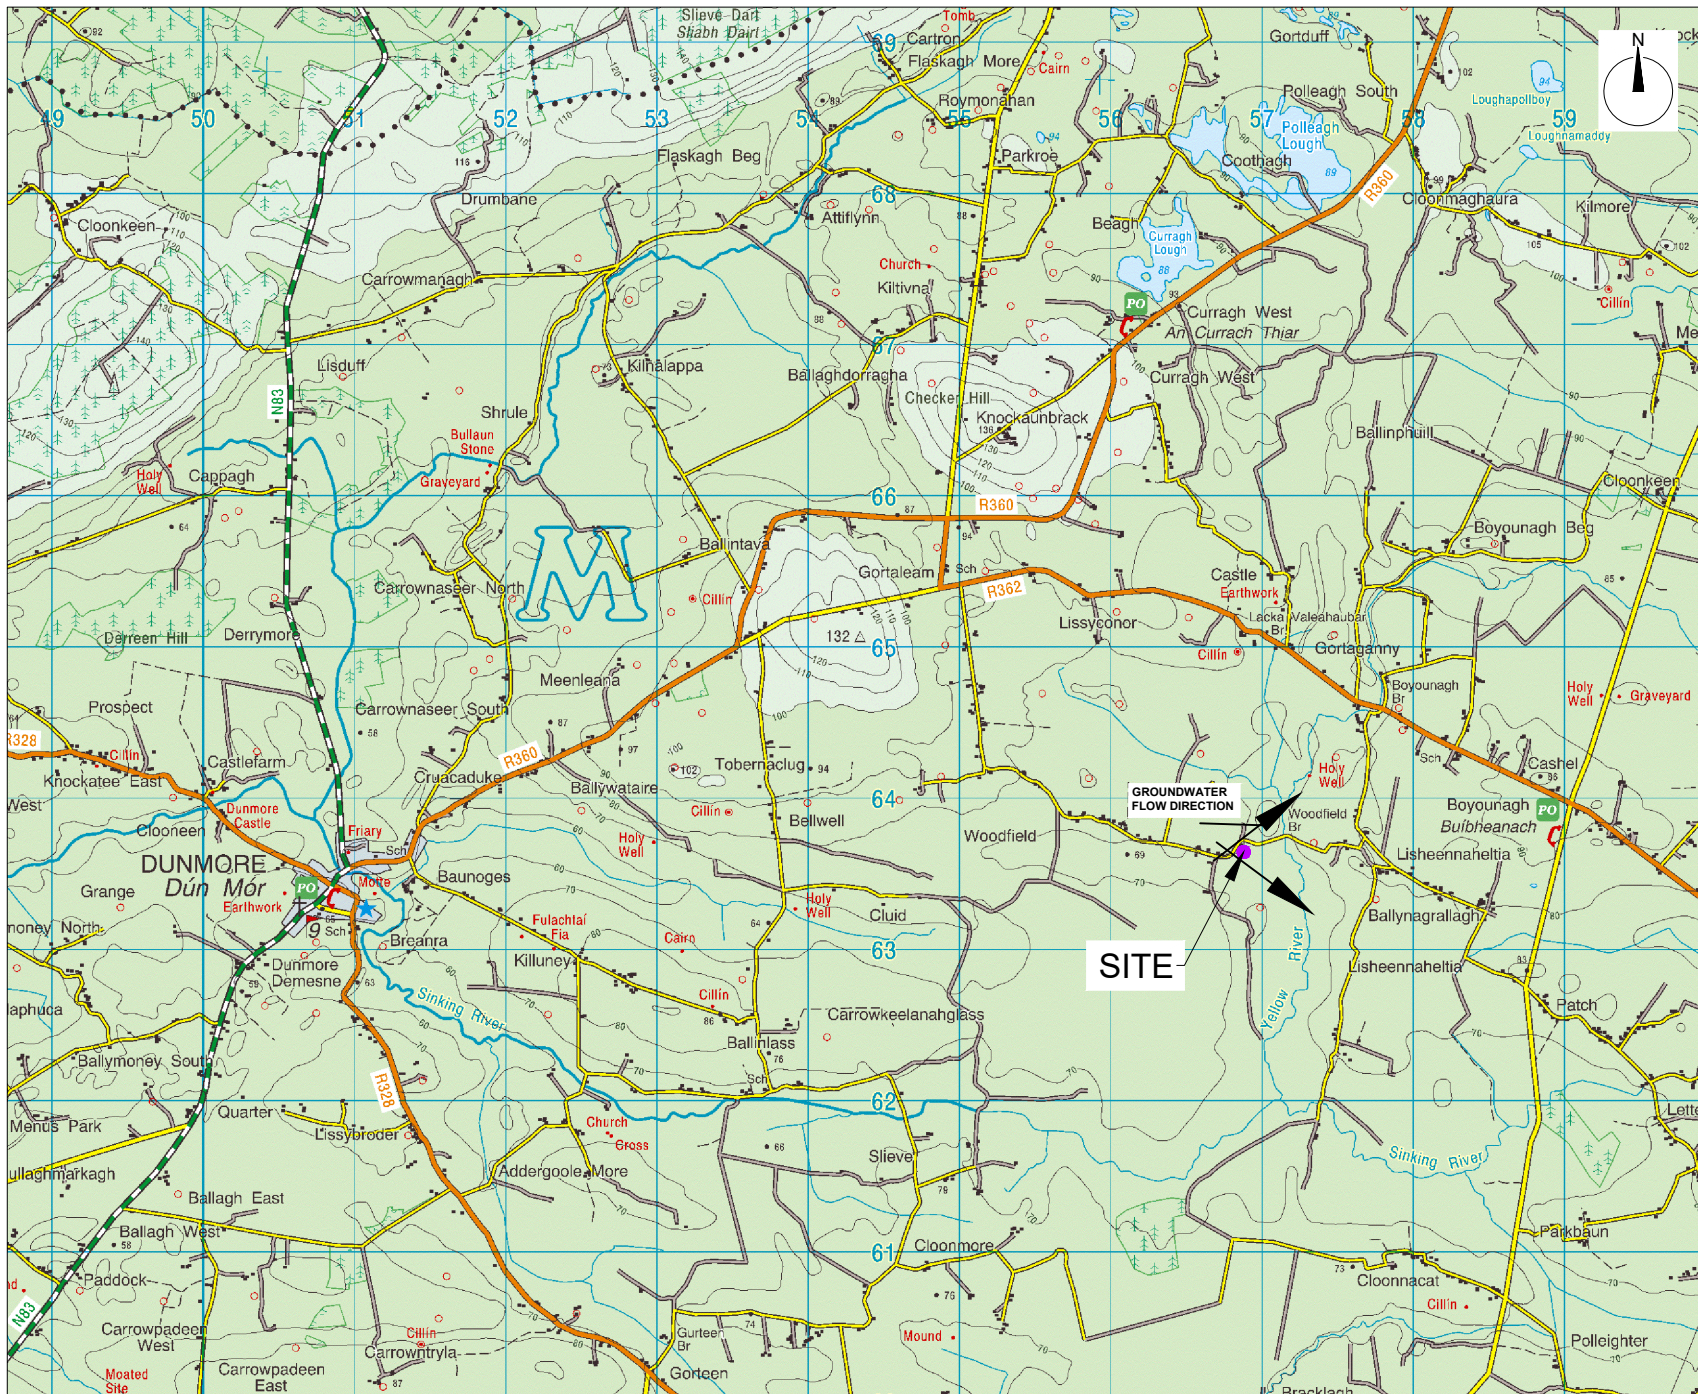

**SITE IDENTIFICATION MAP**      Scale 1:50,000

# Rebuilding Ireland

## NOTES:-

**THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION**

- 1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
- 2 ALL LEVELS REFER TO ORDNANCE DATUM (MALIN HEAD).
- 3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
- 4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

## LEGEND:-

NORTH SIGN INDICATED THUS

SITE LOCATION

Ordnance Survey Ireland Licence No.EN 0002620  
© Government of Ireland.  
OS Sheet No. 2543  
 National Mapping Agency

PL.01	Issued for PLANNING APPROVAL	BM	MF	20.11.20
rev.	modifications	by	chkd	date

file	P:\Jod\job6140_GCC-Sheltered Housing\700 Drawings\703 Planning\Site No. 3 Woodfield, Dunmore\01 WP\6140-JOD-XX-ZZ-DR-B-2019 - Discovery Map.dwg
------	---

client **Comhairle Chontae na Gaillimhe**  
Galway County Council

project  
**PROPOSED DEVELOPMENT OF 1 NO. DOMESTIC DWELLING HOUSE & ASSOCIATED WORKS AT WOODFIELD, DUNMORE, CO. GALWAY.**

stage  
**PLANNING**

title  
**SITE IDENTIFICATION MAP**


scale  
**1:50,000 @A4**

surveyed	drawn	checked	date
osi	BM	MF	NOV 2020

© COPYRIGHT OF  
**JENNINGS O'DONOVAN & PARTNERS**  
CONSULTING ENGINEERS,  
FINISKLIN,  
SLIGO,  
IRELAND.  
TEL. +353 (0)71 916 1416  
FAX. +353 (0)71 916 1080  
Email: info@jodireland.com

drawing no.	revision
6140-JOD-XX-ZZ-DR-B-2019	PL.01



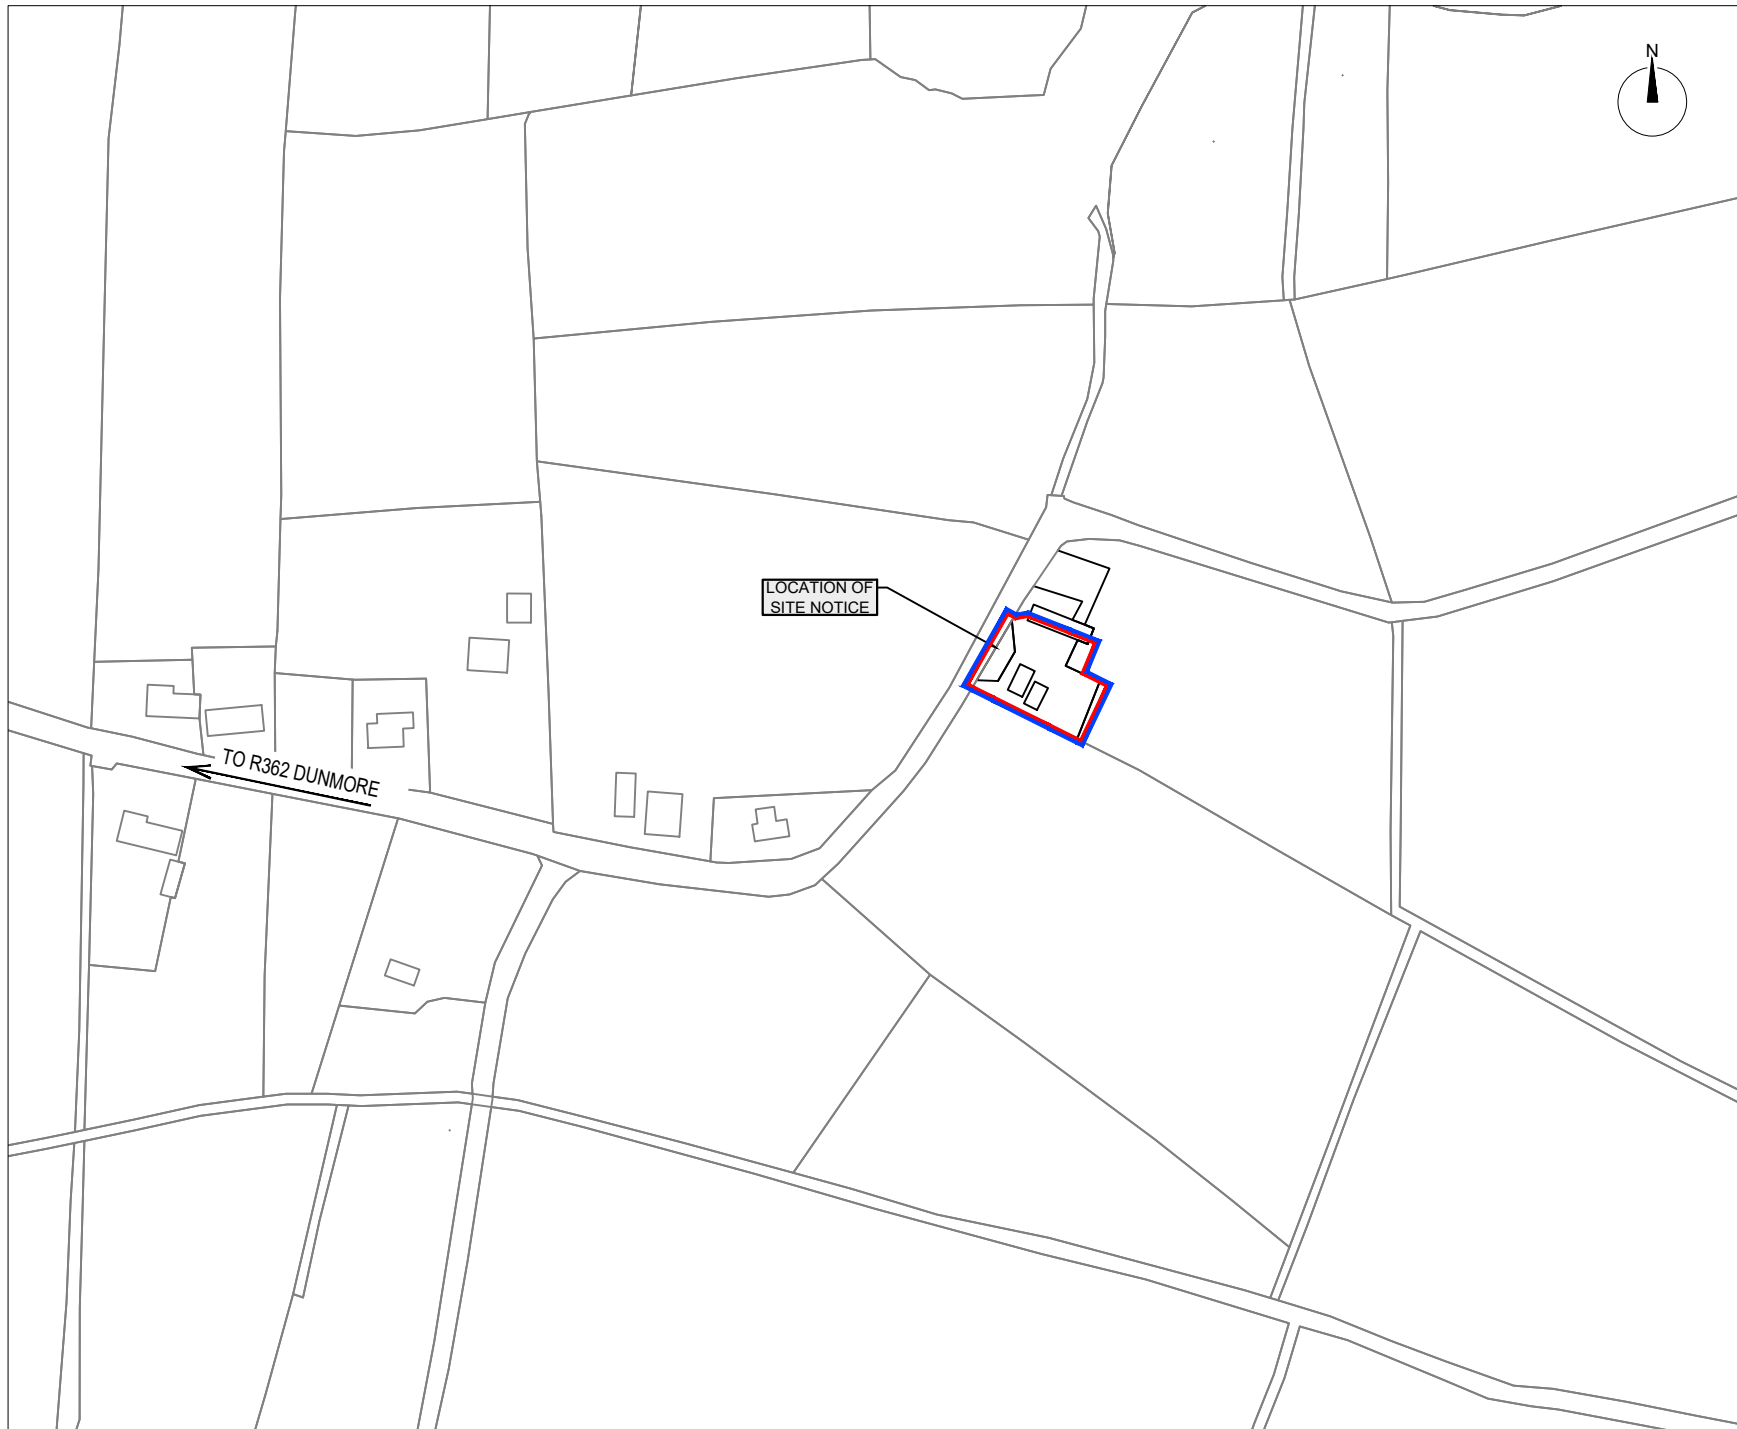

SITE LOCATION MAP Scale 1:2,500

Rebuilding  
Ireland

NOTES:-

THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION

- 1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
- 2 ALL LEVELS REFER TO ORDNANCE DATUM (MALIN HEAD).
- 3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
- 4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

LEGEND:-

SITE BOUNDARY APPLICABLE TO  
PLANNING APPLICATION LINED RED  
LAND UNDER CONTROL OF APPLICANT  
LINED IN BLUE  
NORTH SIGN INDICATED THUS



Site Area:-  
1117 m<sup>2</sup>, 0.276 Acres, 0.112 Hectares

ITM Co-Ordinates of site:-  
556818, 763698

Ordnance Survey Ireland Licence No.EN 0002620  
© Government of Ireland.  
QS Sheet No. 2543



PL.01	issued for PLANNING APPROVAL	BM	MF	20.11.20
rev.	modifications	by	chkd	date

file	P:\Jod\job6140_GCC-Sheltered Housing\700 Drawings\703 Planning\Site No. 3 Woodfield, Dunmore\01 WIP\6140-JOD-XX-ZZ-DR-B-2020 - Site Location Map.dwg
------	--

client	 Comhairle Chontae na Gaillimhe Galway County Council
--------	---

project  
PROPOSED DEVELOPMENT OF 1 NO.  
DOMESTIC DWELLING HOUSE &  
ASSOCIATED WORKS AT WOODFIELD,  
DUNMORE, CO. GALWAY.

stage  
PLANNING

title  
SITE LOCATION MAP

scale  
1:2,500 @A4

surveyed	drawn	checked	date
osi	BM	MF	NOV 20

© COPYRIGHT OF  
JENNINGS O'DONOVAN & PARTNERS  
CONSULTING ENGINEERS,  
FINISKLIN,  
SLIGO,  
IRELAND.  
TEL. +353 (0)71 916 1416  
FAX. +353 (0)71 916 1080  
Email: info@jodireland.com



drawing no.	revision
6140-JOD-XX-ZZ-DR-B-2020	PL.01





**NOTES:-**

**THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION**

- 1 FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
- 2 ALL LEVELS REFER TO ORDNANCE DATUM (MALIN HEAD).
- 3 ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
- 4 THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

**LEGEND:-**

SITE BOUNDARY APPLICABLE TO PLANNING APPLICATION LINED RED

LAND UNDER CONTROL OF APPLICANT LINED IN BLUE

NORTH SIGN INDICATED THUS

EXISTING GROUND LEVELS INDICATED THUS

EXISTING ESB OVERHEAD POWER LINE INDICATED THUS

EXISTING TREES/HEDGEROW

PERCOLATION TEST AREA

PERCOLATION 'T' & 'P' TEST LOCATIONS

TRAIL PIT No. 1 / 2 TEXT LOCATIONS

Site Area:-  
1117 m<sup>2</sup>, 0.276 Acres, 0.112 Hectares

ITM Co-Ordinates of site:-  
556818, 763698

Ordnance Survey Ireland Licence No.EN 0002620  
© Government of Ireland.

OS Sheet No. 2678

Ordnance Survey Ireland  
National Mapping Agency

PL.01	Issued for PLANNING APPROVAL	BM	MF	20.11.20
rev.	modifications	by	chkd	date
Layout Ref.:				
file P:\Jod\jobs\6140_GCC-Sheltered Housing\700 Drawings\703 Planning\Site No. 3 Woodfield, Dunmore\01 WIP\6140-JOD-XX-ZZ-DR-B-2021-P.01 Existing Site Layout Site 3 Final.dwg				

client	Comhairle Chontae na Gaillimhe Galway County Council			
project	PROPOSED DEVELOPMENT OF 1 NO. DOMESTIC DWELLING HOUSE & ASSOCIATED WORKS AT WOODFIELD, DUNMORE, CO. GALWAY.			
stage	PLANNING			
title	EXISTING SITE LAYOUT PLAN			
scale	1:500 @ A3			
surveyed	drawn	checked	date	
OSI	BM	MF	NOV 2020	

© COPYRIGHT OF

**JENNINGS O'DONOVAN & PARTNERS**  
CONSULTING ENGINEERS,  
FINISKLIN,  
SLIGO,  
IRELAND.

TEL. +353 (0)71 916 1416  
FAX. +353 (0)71 916 1080  
Email: info@jodireland.com

drawing no.	revision
6140-JOD-XX-ZZ-DR-B-2021	PL.01

EXISTING SITE LAYOUT PLAN Scale 1:500






NOTES:-

- THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION
- FIGURED DIMENSIONS ONLY TO BE TAKEN FROM THIS DRAWING.
  - ALL LEVELS REFER TO ORDNANCE DATUM (MALIN HEAD).
  - ENGINEER TO BE INFORMED OF ANY DISCREPANCIES BEFORE ANY WORK COMMENCES.
  - THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.

LEGEND:-

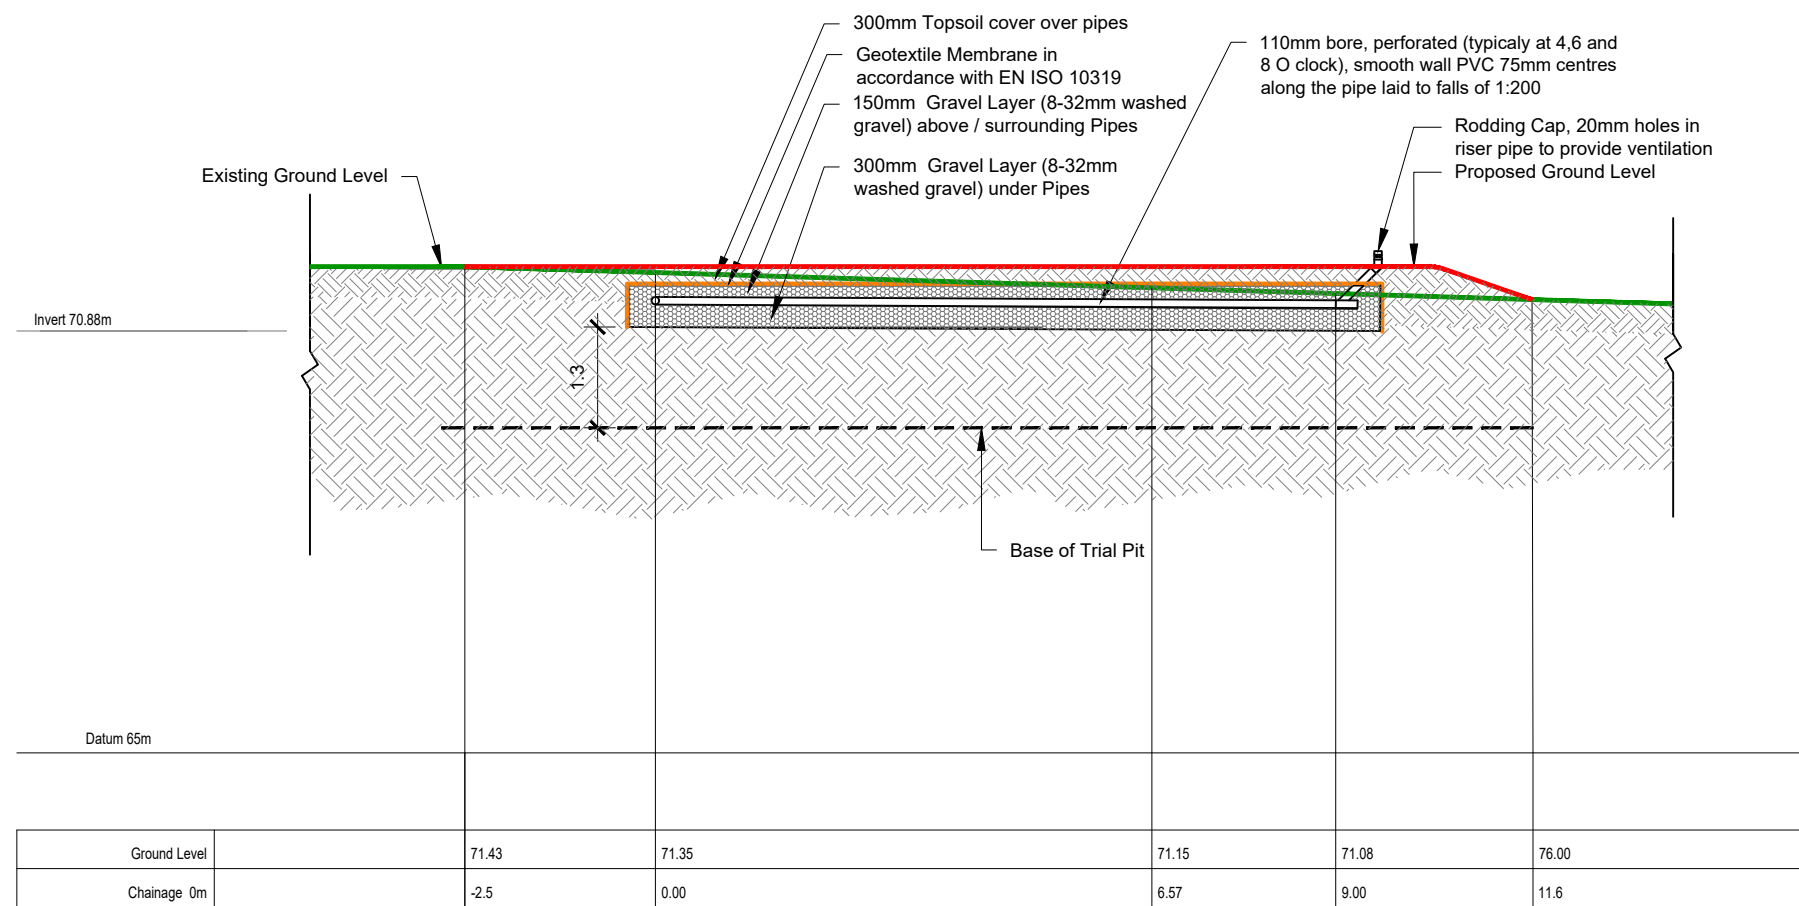

POLISHING FILTER LONGITUDINAL SECTION A-A THROUGH TRENCH  
Scale 1:100

client  **Comhairle Chontae na Gaillimhe**  
Galway County Council

project  
PROPOSED DEVELOPMENT OF 1 NO.  
DOMESTIC DWELLING HOUSE &  
ASSOCIATED WORKS AT WOODFIELD,  
DUNMORE, CO. GALWAY.

stage  
PLANNING

title  
POLISHING FILTER SECTION A-A

scale  
1:100 @ A3

surveyed OSI	drawn BM	checked MF	date NOV 2020
-----------------	-------------	---------------	------------------

© COPYRIGHT OF  
**JENNINGS O'DONOVAN & PARTNERS**  
CONSULTING ENGINEERS,  
FINISKLIN,  
SLIGO,  
IRELAND.  
TEL. +353 (0)71 916 1416  
FAX. +353 (0)71 916 1080  
Email: [info@jodireland.com](mailto:info@jodireland.com)



drawing no. 6140-JOD-XX-ZZ-DR-B-2023	revision PL.01
---	-------------------


# **APPENDIX D**

## **SUPPORTING DOCUMENTS RELATING TO PROPOSED EFFLUENT TREATMENT SYSTEM**

### **Proposed Secondary Treatment System – Solido SMART (6PE)**

- Solido SMART (S.B.R.) Brochure
- Solido SMART (S.B.R.) PIA Certification

# The new generation in Decentralised Wastewater Treatment

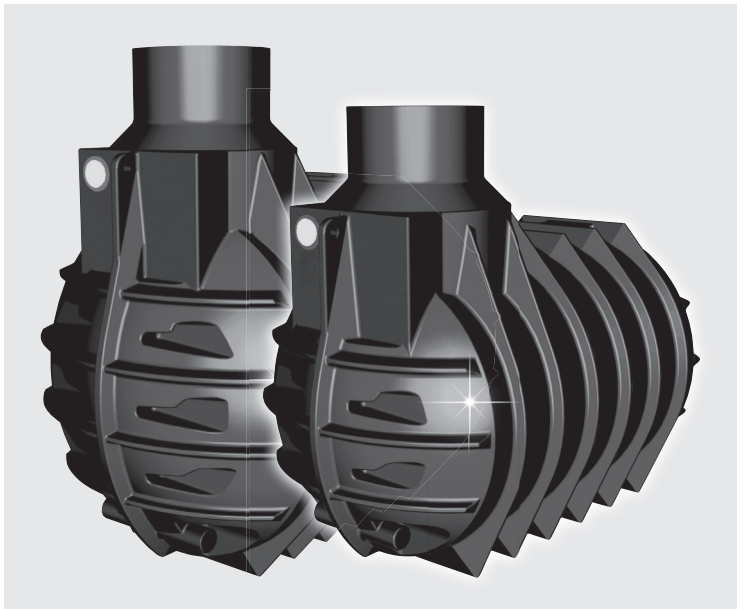




# The new generation in Decentralised Wastewater Treatment

The Solido SMART from Premier Tech, is a decentralised wastewater treatment plant and the perfect solution for residential and commercial projects where mains drainage is unavailable.

Serving a population of up to 9 PE and fast becoming the industry's system of choice; this low-profile unit offers a reliable design and low installation costs. Available in gravity and integrated pumped outlet versions. Installed to treat wastewater with minimal impact on the environment, typical applications include single dwellings, small communities.

## Superior Technical Performance

The highly successful Solido SMART is designed and tested in accordance with EN12566-3, in compliance with S.R 66:2015. This plant is able to produce a final effluent quality better than 10:20:5 (BOD:SS:NH<sub>3</sub>). Removal of total nitrogen and total phosphorus (TN and TP) is expected to reach 83% and 68% respectively.

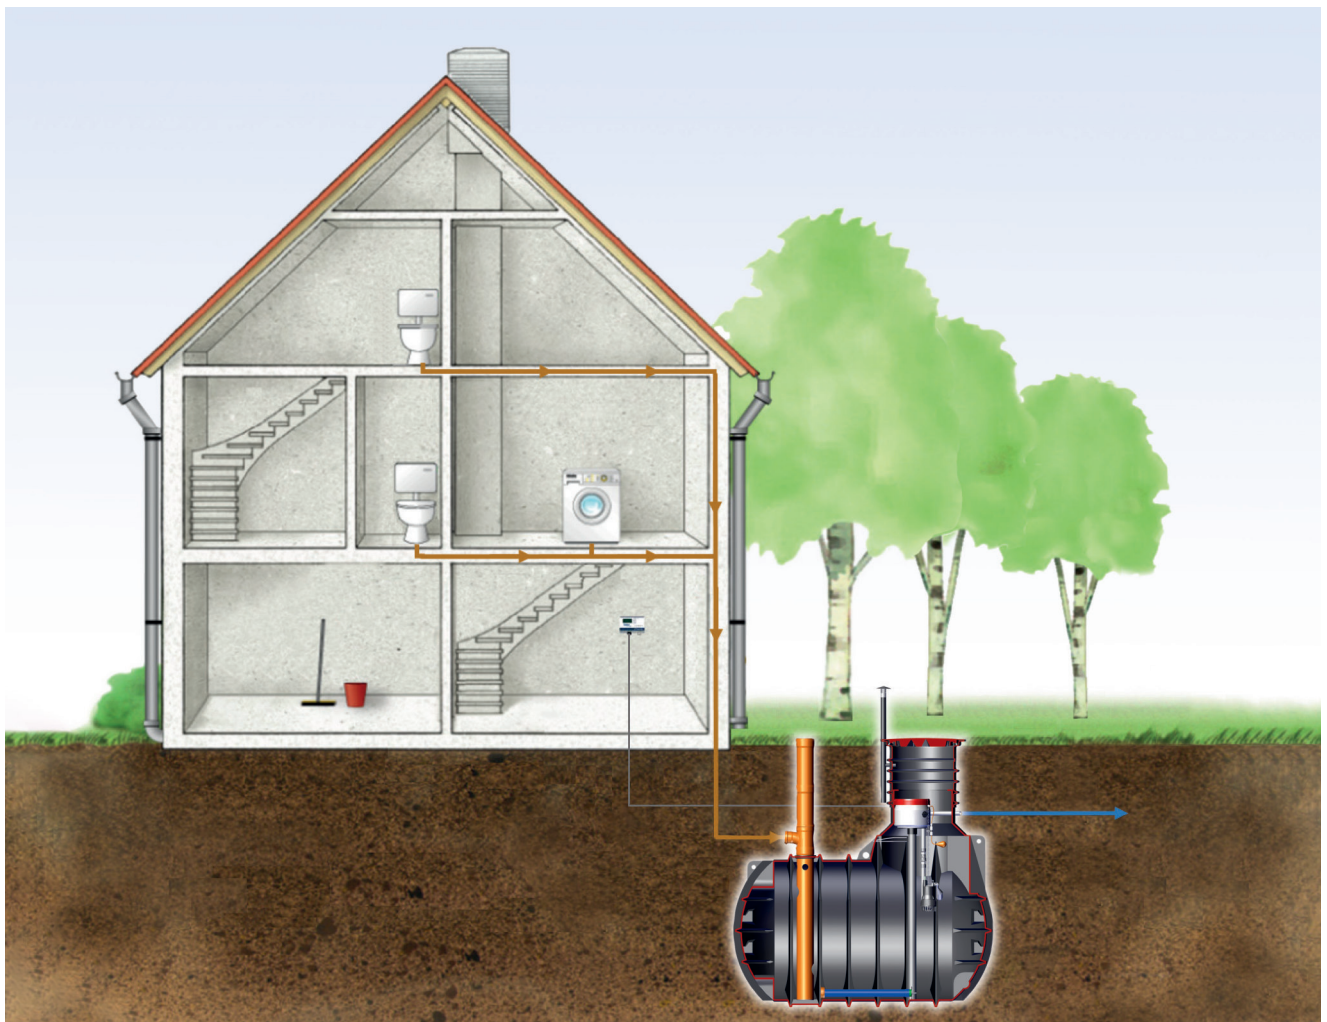

# Solido SMART

## State of the art SBR Treatment

### Advanced Technical Qualities

The Solido SMART solution makes decentralised wastewater treatment easier and more efficient than ever. Trust its high-quality design and durable components to provide long-term performances and peace of mind.

- Low operational cost, offering long term savings.
- Discrete and silent treatment plant.
- Reduced installation and maintenance costs, Solido SMART tanks are lightweight, compact and have low installation depth requirements.
- Fully CE marked. Designed and tested in accordance with EN 12566-3.
- Polyethylene material - durable, recyclable and impact resistant.



### How it works

Solido SMART combines the benefits of an ultra-compact solution with the trusted performance of Solido technology. Integrating with SBR technology comparable to large municipal applications, the proven technology operates with direct aeration of the wastewater and without the need for primary treatment. This simple principle provides efficient wastewater treatment results without the emission of any odours.

### 1. Technology Capsule

Safely housed in the capsule, the compressor requires only 0.80 - 1.04 kWh/d for 6 - 9 PE plants respectively - providing an efficient and quiet treatment without disturbance to the homeowner.

### 2. Tube Diffuser

The incoming wastewater is immediately supplied with oxygen to ensure a very efficient and odourless treatment.

### 3. The SMART Pipe

Slows down the incoming influent and simplifies inspections. Makes part desludging safe and easy.


### 4. Clearwater Pump (Pumped outlet only)

### 5. Clearwater Air Lift (Gravity outlet only)

The patented self-flushing airlift prevents sludge loss and ensures high performances.


### 6. Solido-Tank

Manufactured seamlessly as one-piece from eco-friendly PE, with 25 years warranty.

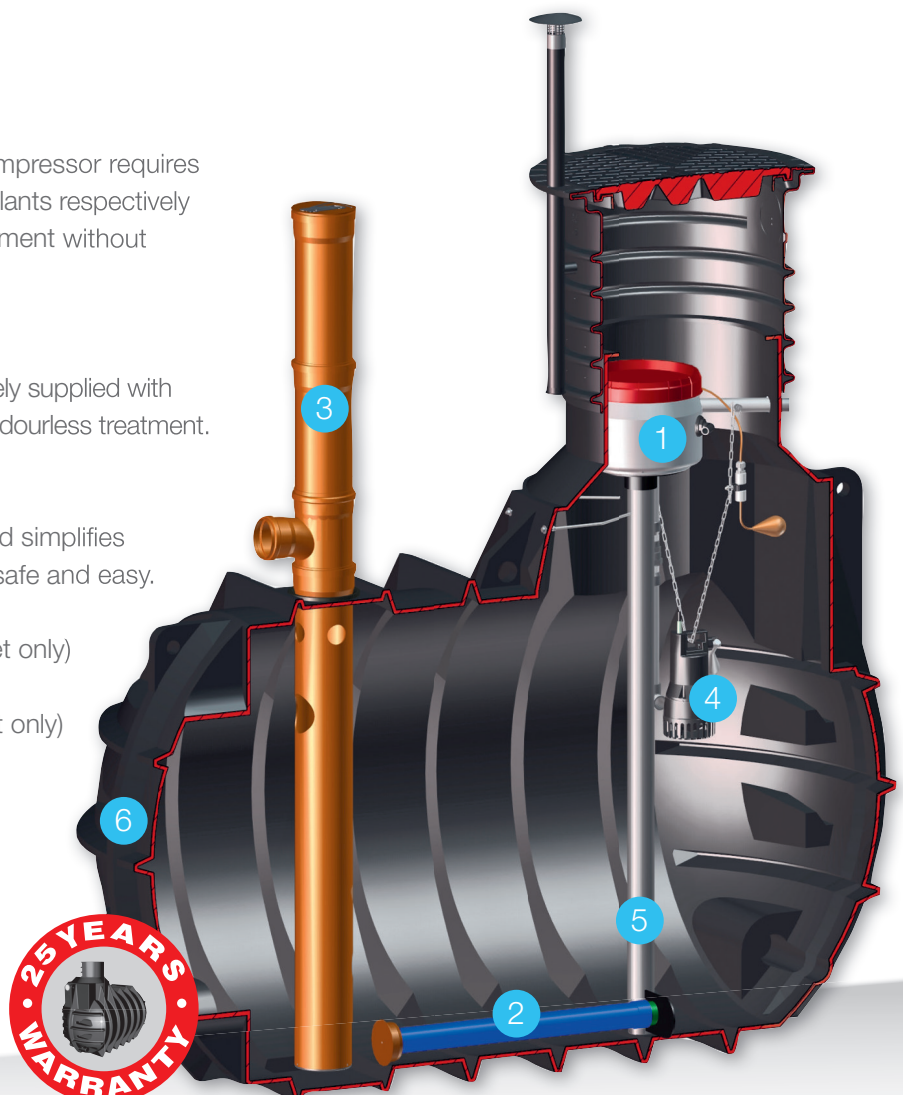

## Solido SMART Plant Size

Plant Size (PE)	discharge	Tank Type	Length (m)	Width (m)	Height (m)	INLET Height to base (m)	OUTLET Height to base (m)	Pipe Diameter (mm)	reference code
6 (max. 0.9 m³/d)	pumped	3000	2.42	1.42	2.06 – 2.47	1.47	1.73	110	KEBL3026
9 (max. 1.35 m³/d)	pumped	4500	2.42	1.79	2.34 – 2.75	1.74	2.06	110	KEBL4526
6 (max. 0.9 m³/d)	gravity	3000	2.42	1.42	2.06 – 2.47	1.47	1.40	110	KCBL3020
9 (max. 1.35 m³/d)	gravity	4500	2.42	1.79	2.34 – 2.75	1.74	1.73	110	KCBL4520

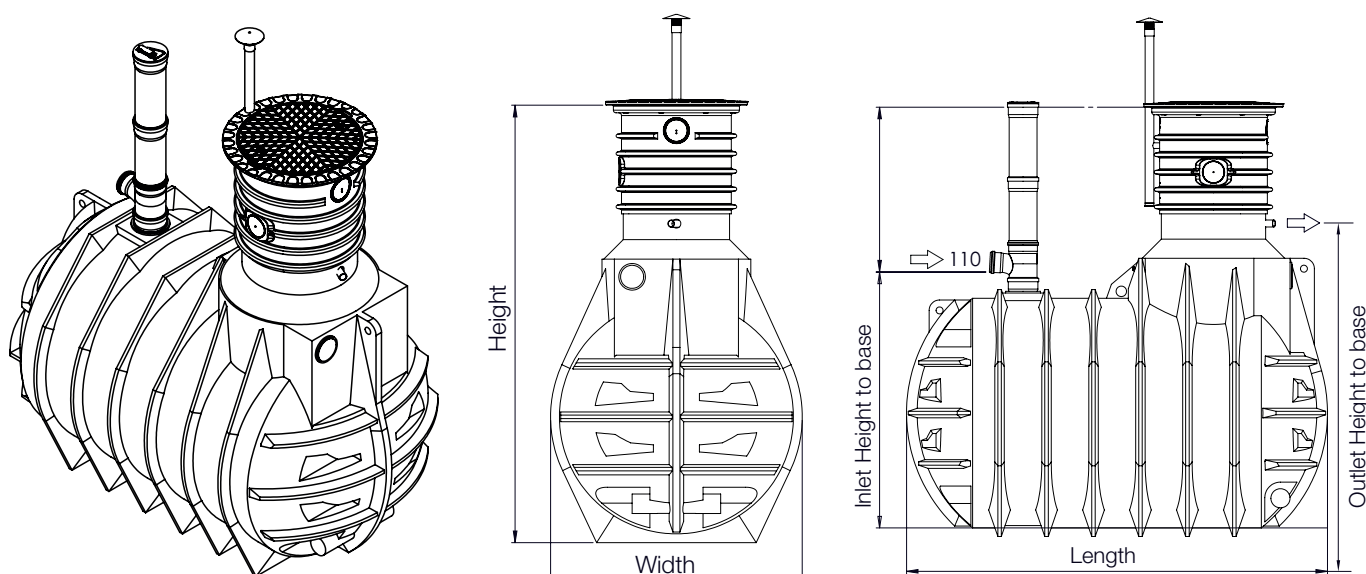

## Installation

The Solido SMART Sewage Treatment Plant requires a relatively low cost and easy installation process. As the tank is super reinforced, concrete is not needed and the tank can be fully installed in free flowing granular backfill.


## Warranty


All Premier Tech PE tanks come with a 25 year warranty as standard. Individual product and part warranties are available upon request.

Premier Tech work closely with a nationwide network of installation partners and detailed installation guidelines are provided with each product.

All electric work should be carried out in accordance with current regulations.



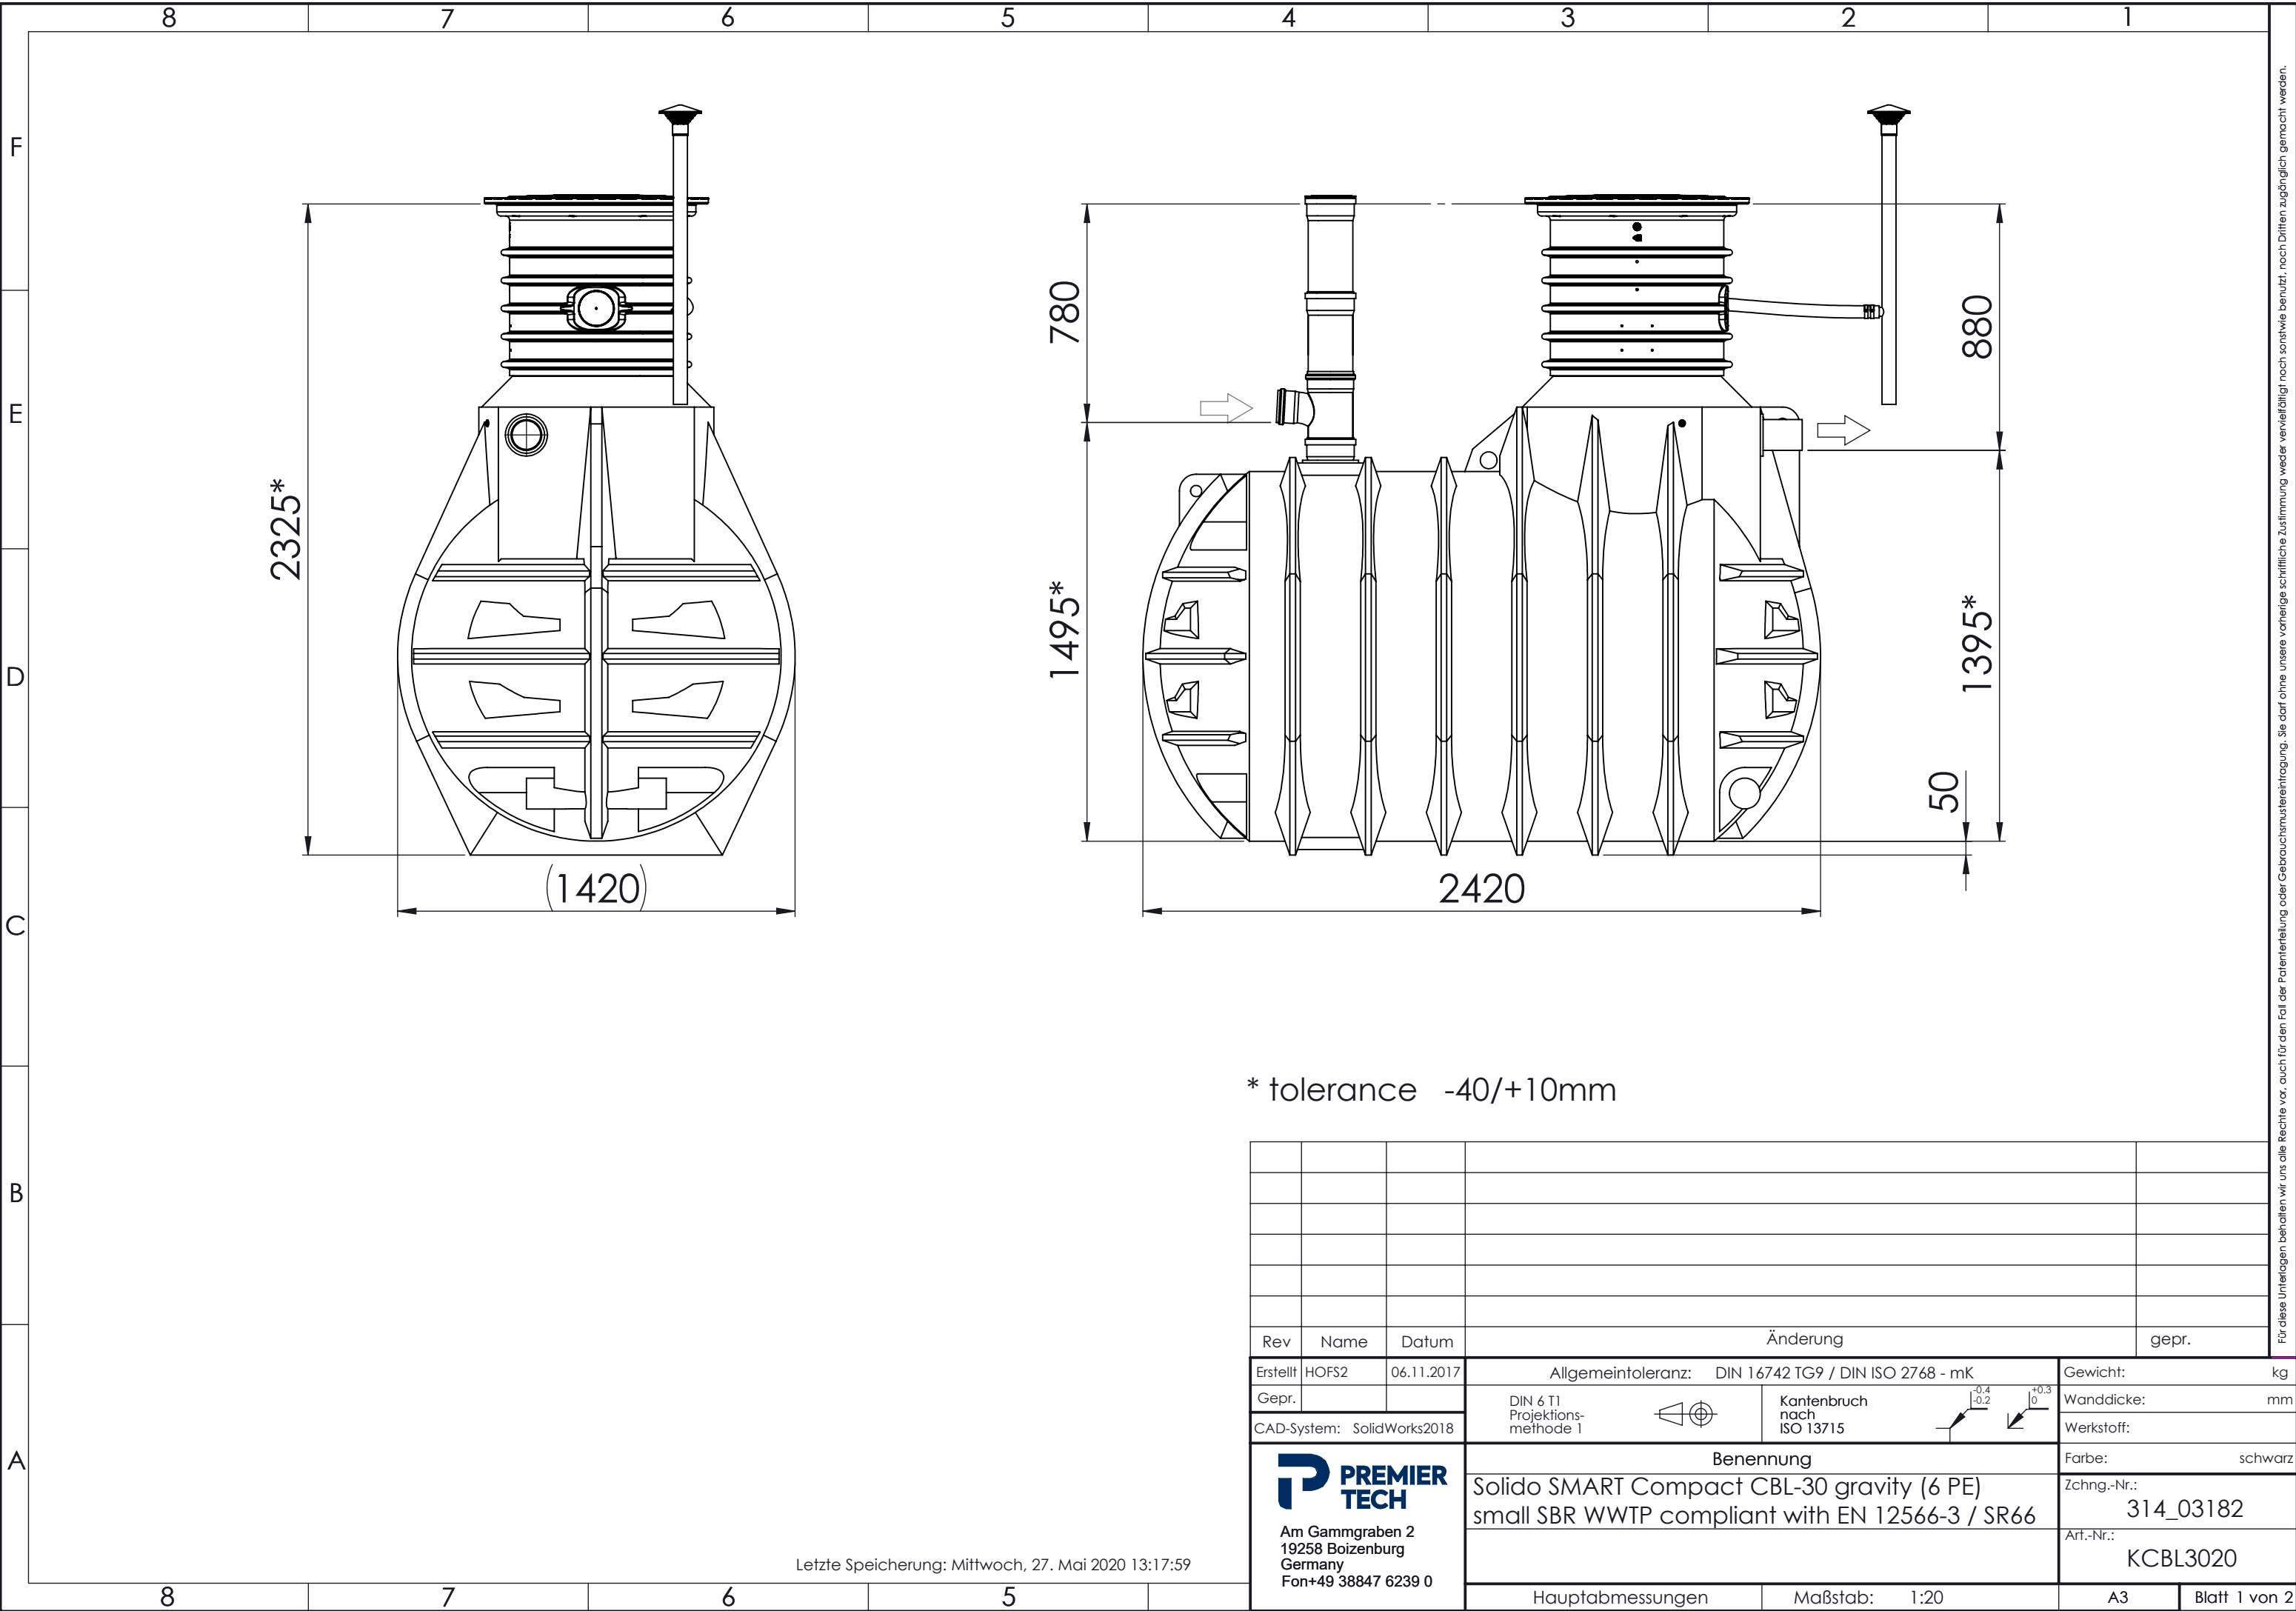

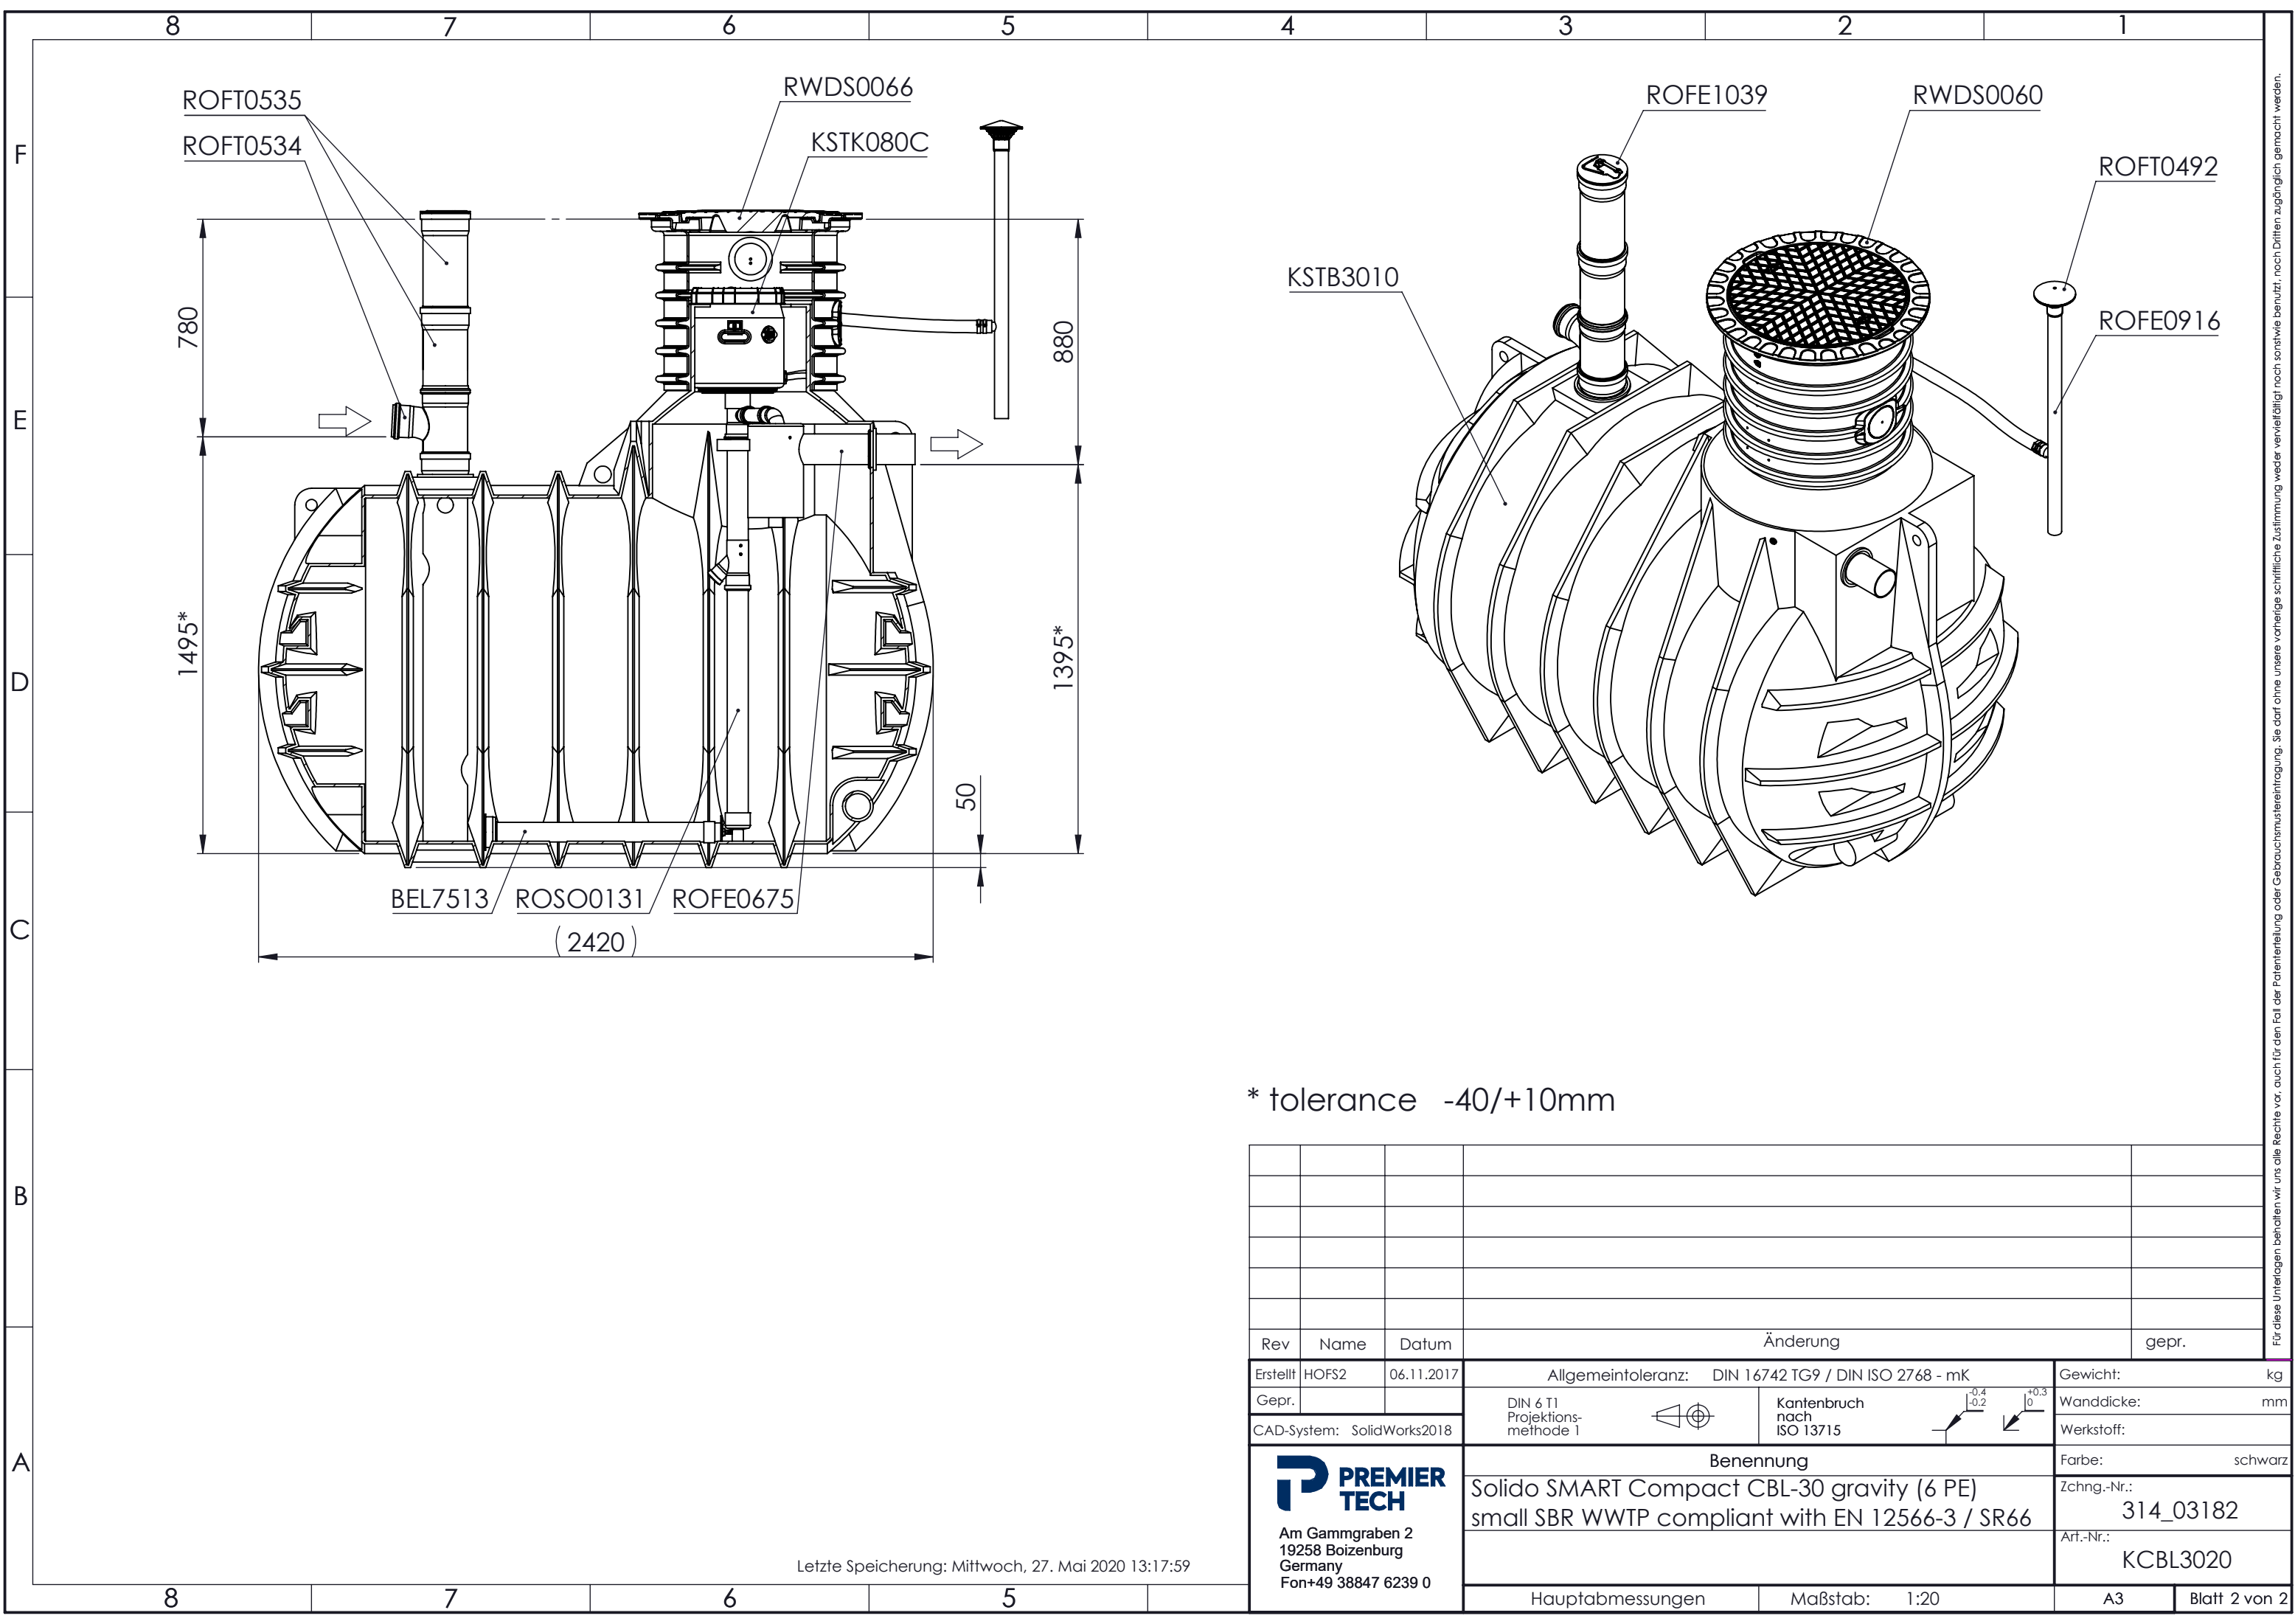

\* tolerance -40/+10mm

Rev	Name	Datum	Änderung		gepr.
Erstellt	HOF52	06.11.2017	Allgemeintoleranz: DIN 16742 TG9 / DIN ISO 2768 - mK		Gewicht: kg
Gepr.			DIN 6 T1 Projektions- methode 1	Kantenbruch nach ISO 13715	Wanddicke: mm
CAD-System: SolidWorks2018					Werkstoff:
<div><div></div><div><b>PREMIER TECH</b></div><div>Am Gammgraben 2 19258 Boizenburg Germany Fon+49 38847 6239 0</div></div>			Benennung		Farbe: schwarz
			Solido SMART Compact CBL-30 gravity (6 PE) small SBR WWTP compliant with EN 12566-3 / SR66		Zchng.-Nr.: 314_03182
					Art.-Nr.: KCBL3020
			Hauptabmessungen	Maßstab: 1:20	A3 Blatt 2 von 2

Für diese Unterlagen behalten wir uns alle Rechte vor, auch für den Fall der Patenterteilung oder Gebrauchsmusterteilung. Sie darf ohne unsere vorherige schriftliche Zustimmung weder vervielfältigt noch sonstwie benutzt, noch Dritten zugänglich gemacht werden.



# Certificate

## TREATMENT PERFORMANCE RESULTS

**Premier Tech Aqua GmbH**

Bei der neuen Münze 11, 22145 Hamburg, Germany

**EN 12566-3**

Results corresponding to EN 12566-3 and S.R. 66

PIA-SR66-1604-1055.02

**SOLIDO smart**

One-chamber SBR system in one PE tank

Nominal organic daily load	0.30 kg/d	
Nominal hydraulic daily load	0.90 m³/d	
Material	Polyethylene	
Watertightness	Pass	
Structural behaviour (Pit Test)	Pass (also wet conditions)	
Durability	Pass	
Treatment efficiency	Efficiency	Effluent
(nominal sequences)	COD	95.1 % 39 mg/l
	BOD5	98.5 % 5 mg/l
	NH4-N	98.0 % 0.7 mg/l
	SS	97.1 % 13 mg/l
Number of desludging	Not more than once	
Electrical consumption	0.81 kWh/d	

Performance tested by:

**PIA - Prüfinstitut für Abwassertechnik GmbH**

Hergenrather Weg 30

52074 Aachen

Germany

This document replaces neither the declaration of performance nor the CE marking.






Notified Body  
No.: 1739






PIA - Sustainable Certification  
*Oliver V. K. M. W.*  
*L. W. S. T. E. R.*  
geprüft - tested - testé




Verschitz / Wermter September 2019

SOLIDO smart range and its referring test reports:

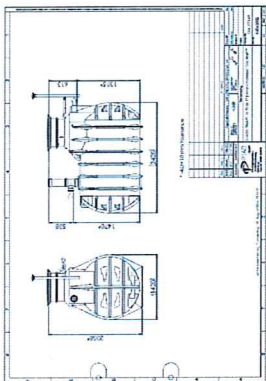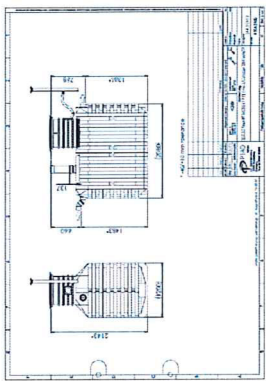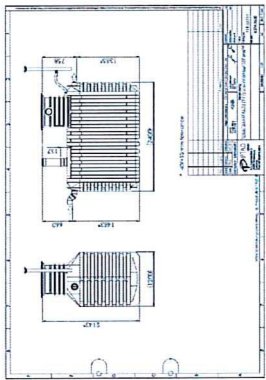
Population equivalent (PE)	Drawing of model of the range	Watertightness (EN 12566-3 Annex A)	Treatment Efficiency (EN 12566-3 Annex B)	Structural Behaviour (EN 12566-3 Annex C)	Durability
Initial Type Test (ITT) 6 900 l/d		Pass PIA2007-WD-003	Pass PIA2015-239B22.e	Pass For wet ground conditions also, 0.95 m installation depth from inlet invert	Pass PIA2016-DH-1510-1052.01
6 900 l/d		Pass PIA2007-WD-003	Pass Range conformity according to S.R. 66:2015	Pass For wet ground conditions, For wet ground conditions also, 1.00 m installation depth from inlet invert	Pass PIA2016-DH-1510-1052.01
7 1050 l/d		Pass PIA2007-WD-003	Pass Range conformity according to S.R. 66:2015	Pass For wet ground conditions, For wet ground conditions also, 1.00 m installation depth from inlet invert	Pass PIA2016-DH-1510-1052.01

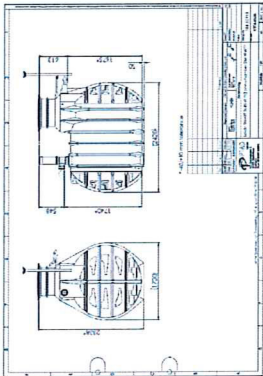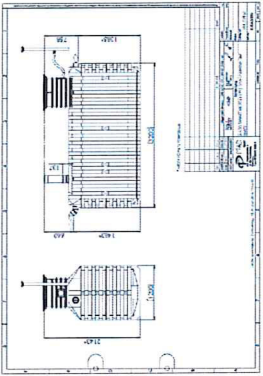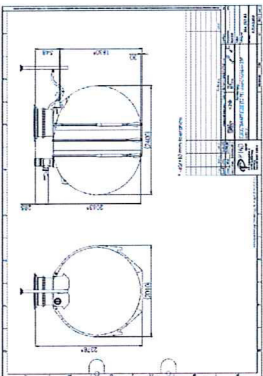

Population equivalent (PE)	Drawing of model of the range	Watertightness (EN 12566-3 Annex A)	Treatment Efficiency (EN 12566-3 Annex B)	Structural Behaviour (EN 12566-3 Annex C)	Durability
9 1350 l/d		Pass  PIA2007-WD-003	Pass  Range conformity according to S.R. 66:2015	Pass  For wet ground conditions also, 0.95 m installation depth from inlet invert	Pass  PIA2016-DH-1510-1052.01
10 1500 l/d		Pass  PIA2007-WD-003	Pass  Range conformity according to S.R. 66:2015	Pass  PIA2006-BT-004  PIA2011-ST-PIT-1105-1032  For wet ground conditions also, 1.00 m installation depth from inlet invert	Pass  PIA2016-DH-1510-1052.01
12 1800 l/d		Pass  PIA2007-WD-003	Pass  Range conformity according to S.R. 66:2015	Pass  For wet ground conditions also, 0.95 m installation depth from inlet invert	Pass  PIA2016-DH-1510-1052.01

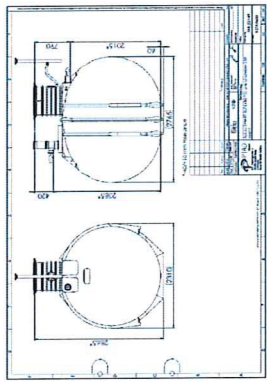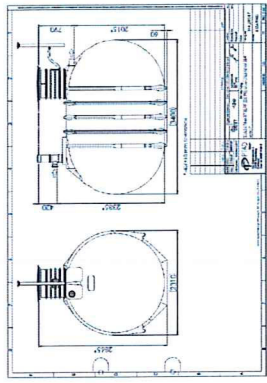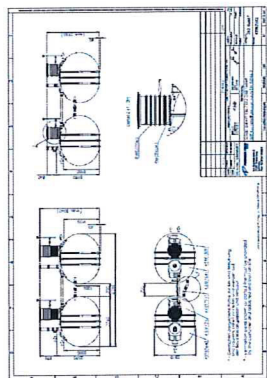Population equivalent (PE)	Drawing of model of the range	Watertightness (EN 12566-3 Annex A)	Treatment Efficiency (EN 12566-3 Annex B)	Structural Behaviour (EN 12566-3 Annex C)	Durability
18 2700 l/d		Pass  PIA2007-WD-003	Range conformity according to S.R. 66:2015	Pass For wet ground conditions also, 0.95 m installation depth from inlet invert	PIA2016-DH-1510-1052.01  pass
25 3750 l/d		Pass  PIA2007-WD-003	Range conformity according to S.R. 66:2015	PIA2015-ST-PIT-1406-1043.01  Pass For wet ground conditions also, 0.95 m installation depth from inlet invert	PIA2016-DH-1510-1052.01  pass
40 6,000 l/d		Pass  PIA2007-WD-003	Range conformity according to S.R. 66:2015	Pass For wet ground conditions also, 0.95 m installation depth from inlet invert	PIA2016-DH-1510-1052.01  pass

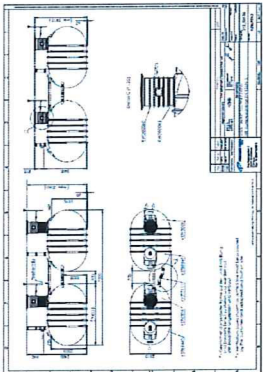

Population equivalent (PE)	Drawing of model of the range	Watertightness (EN 12566-3 Annex A)	Treatment Efficiency (EN 12566-3 Annex B)	Structural Behaviour (EN 12566-3 Annex C)	Durability
50 7,500 l/d		Pass PIA2007-WD-003	Range conformity according to S.R. 66:2015	Pass For wet ground conditions also, 0.95 m installation depth from inlet invert	PIA2016-DH-1510-1052.01 pass





